



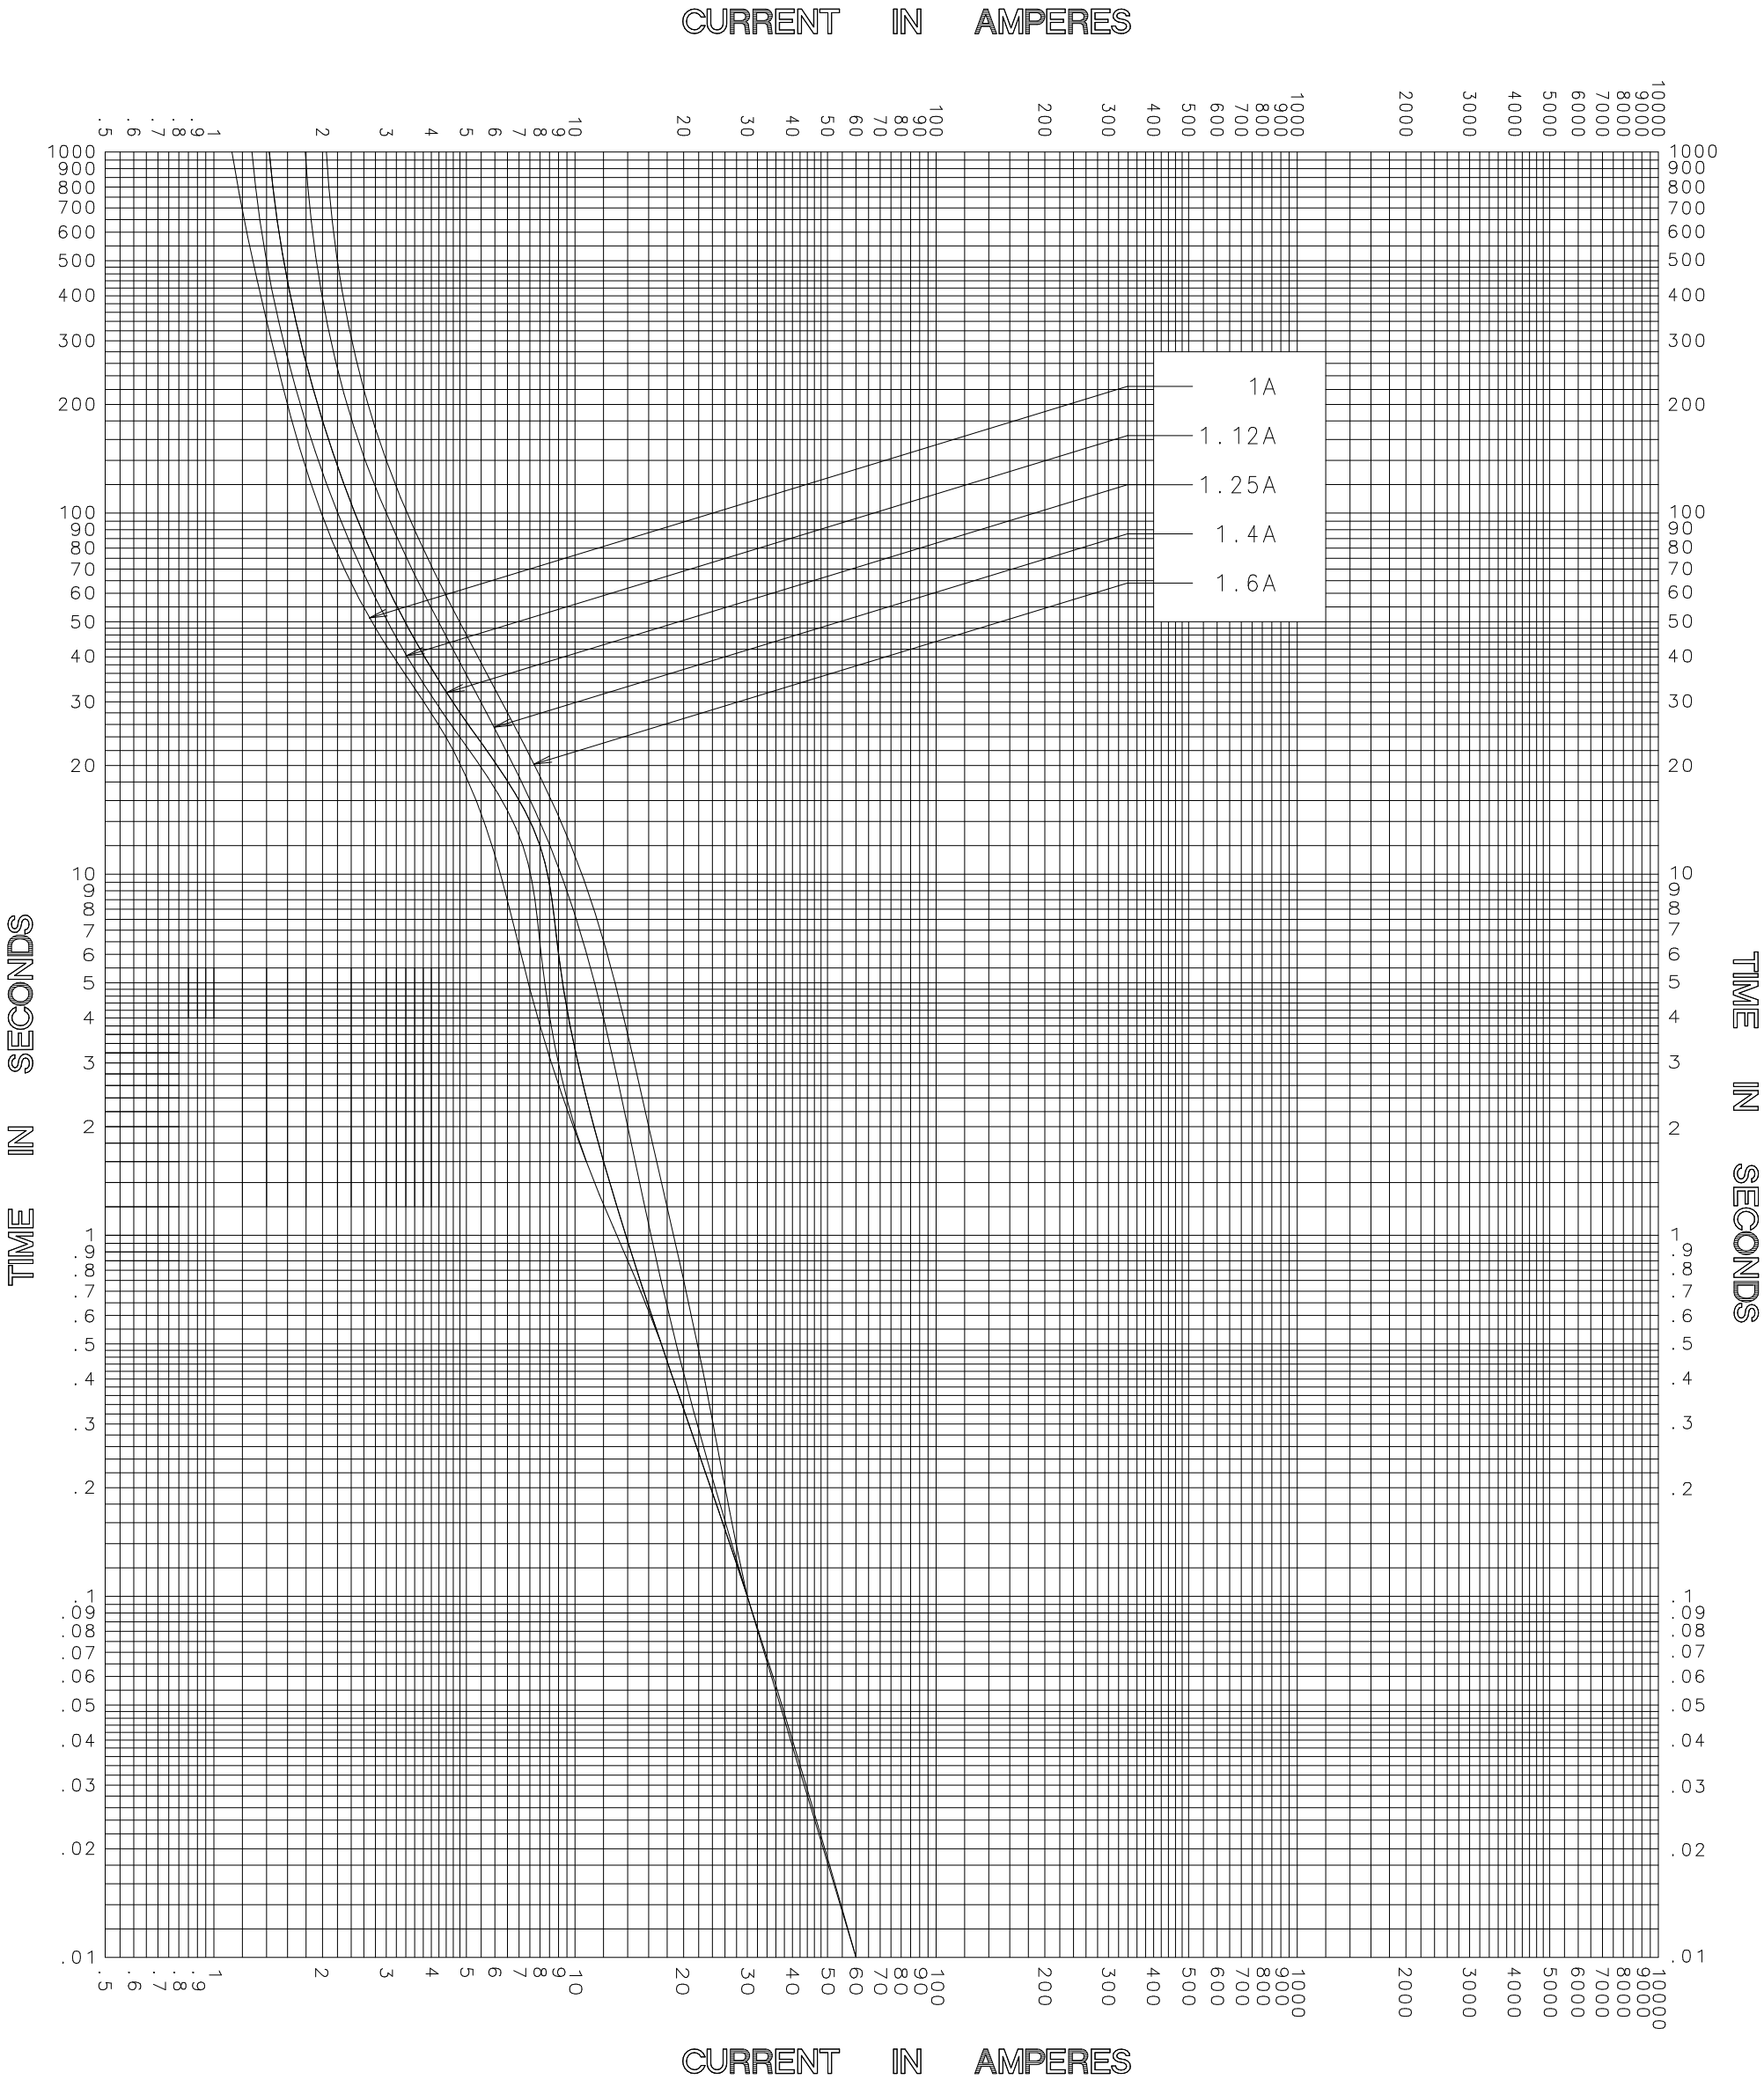

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____	FUSE CATALOG NUMBER LLSRK (1A - 1.6A) ID
 DES PLAINES, ILLINOIS 60016	DRAWN BY <u>LLL</u> DATE <u>12/03/04</u> CHECKED BY <u>MP</u>
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. B-FCC01-LSRKID-002

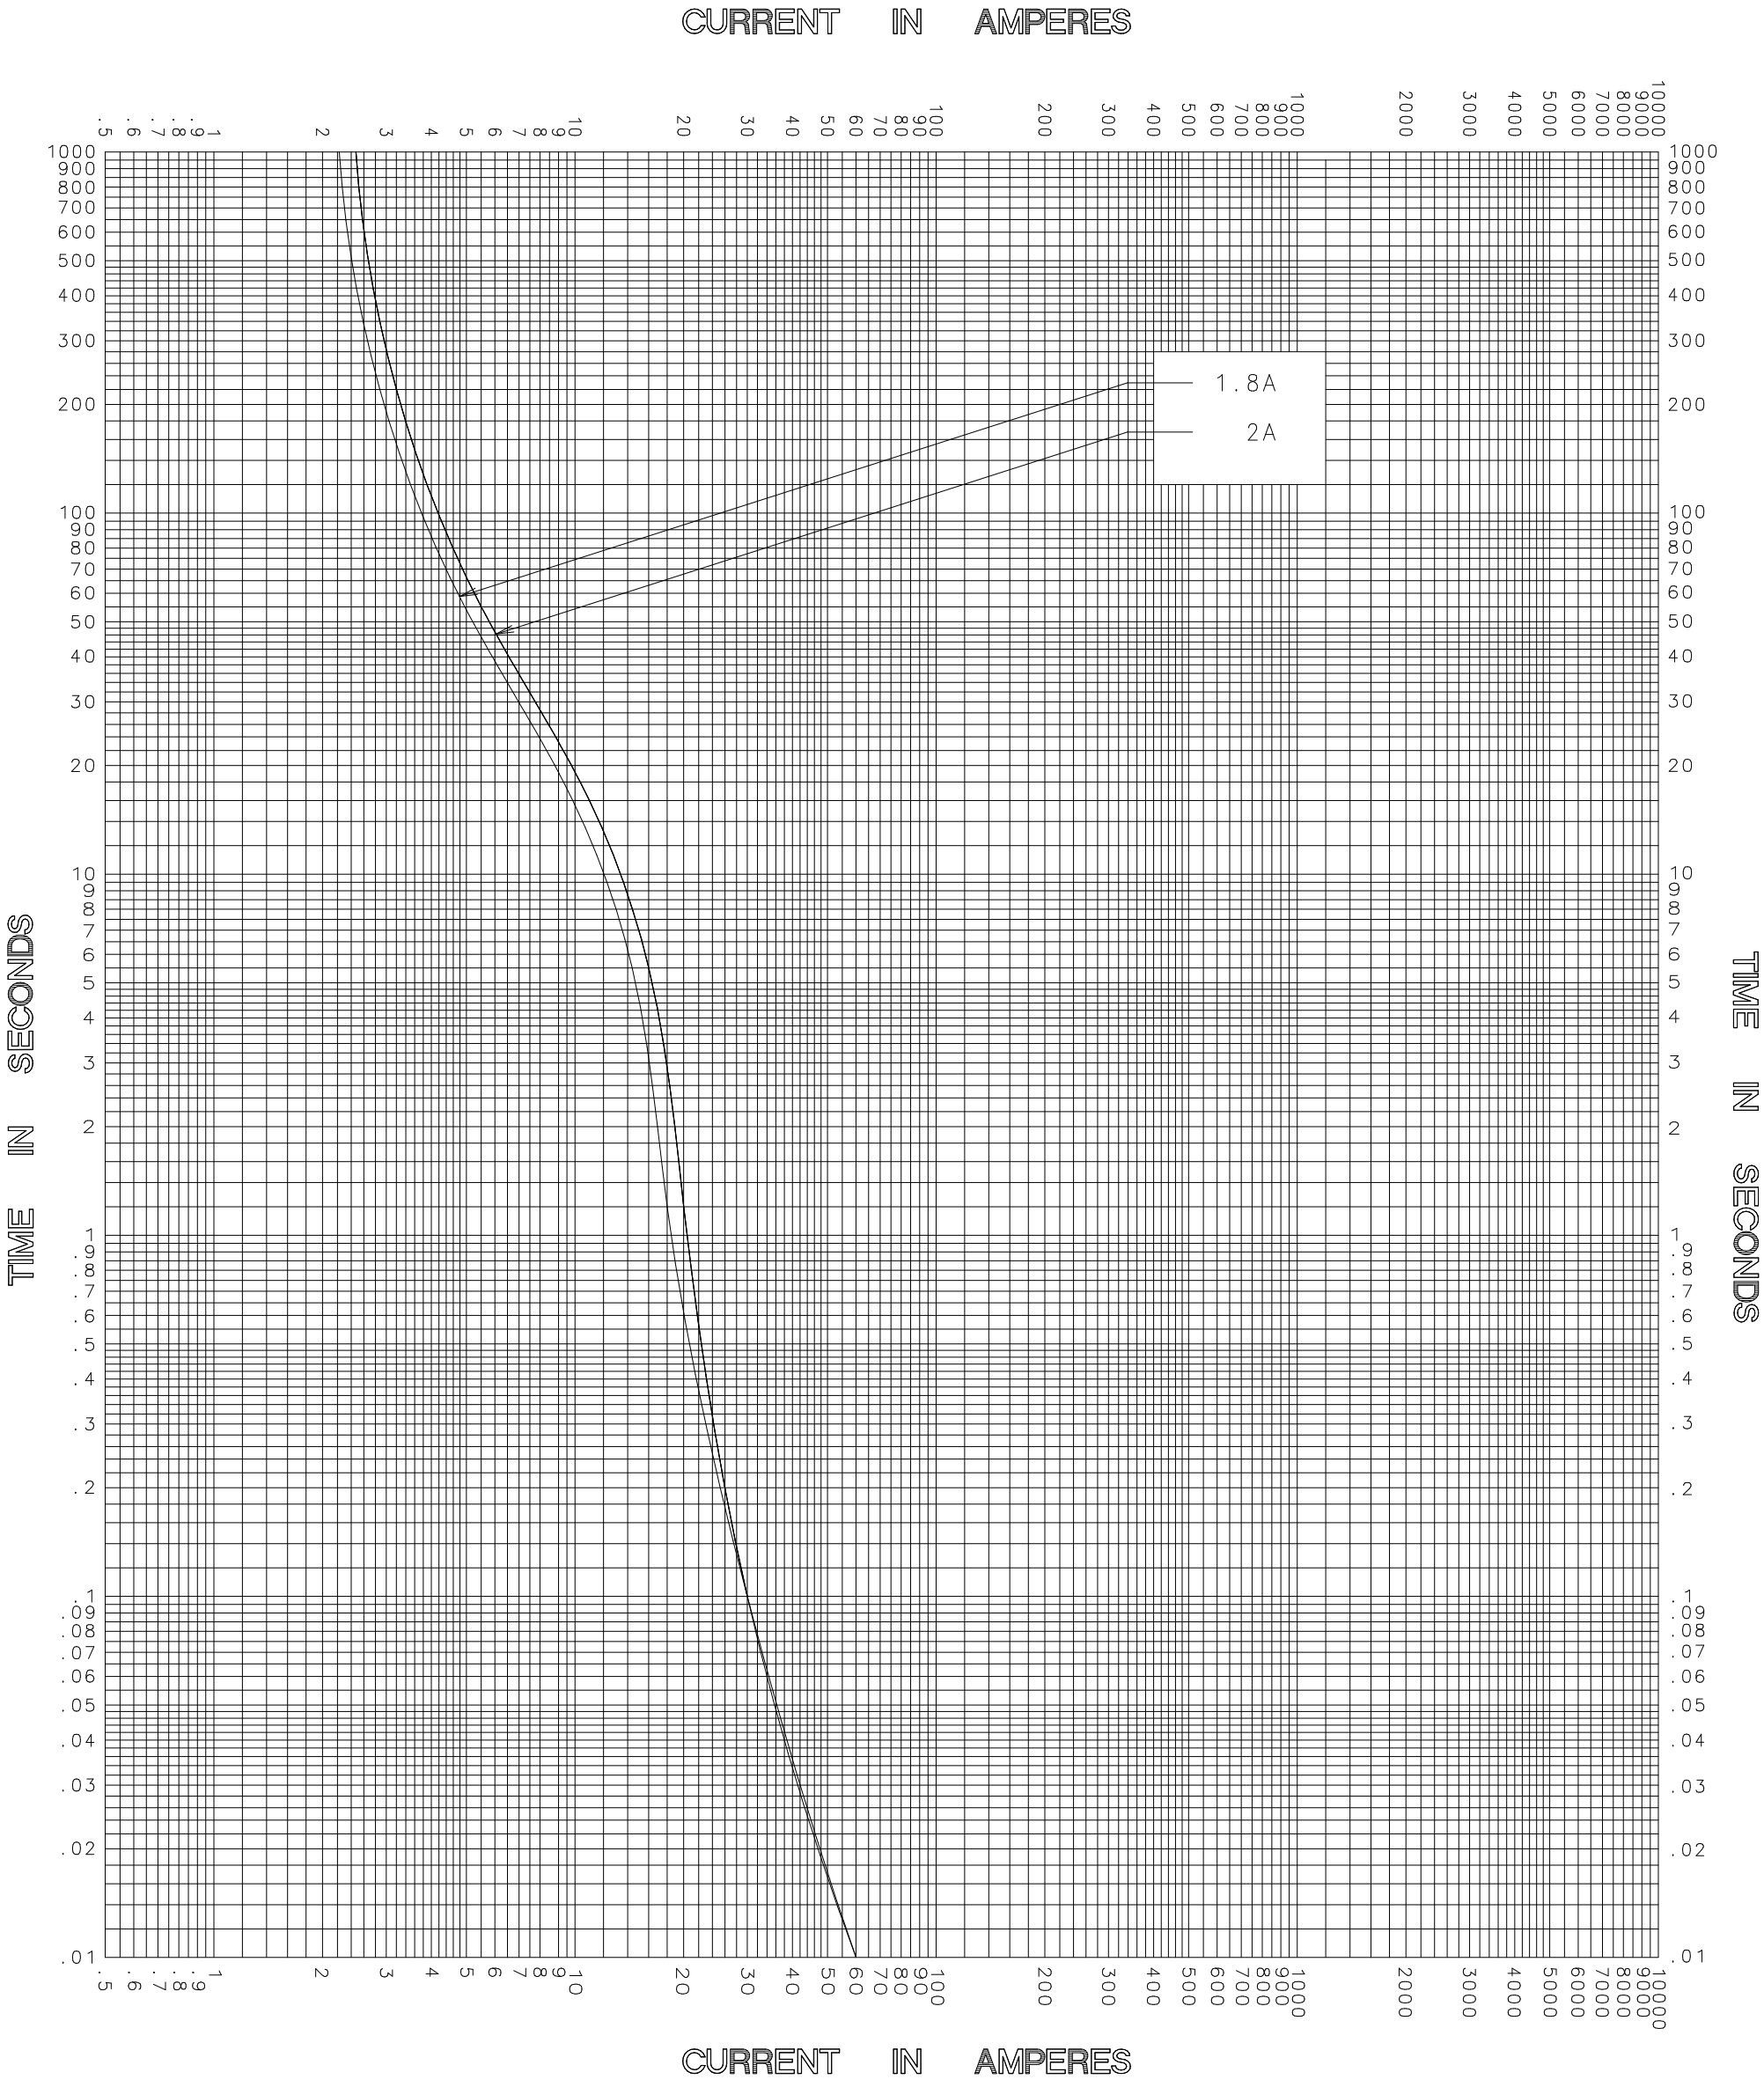

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____


FUSE CATALOG NUMBER
LLSRK (1.8A - 2A) ID



DRAWN BY LLL
DATE 12/03/04
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
B-FCC01-LSRKID-003

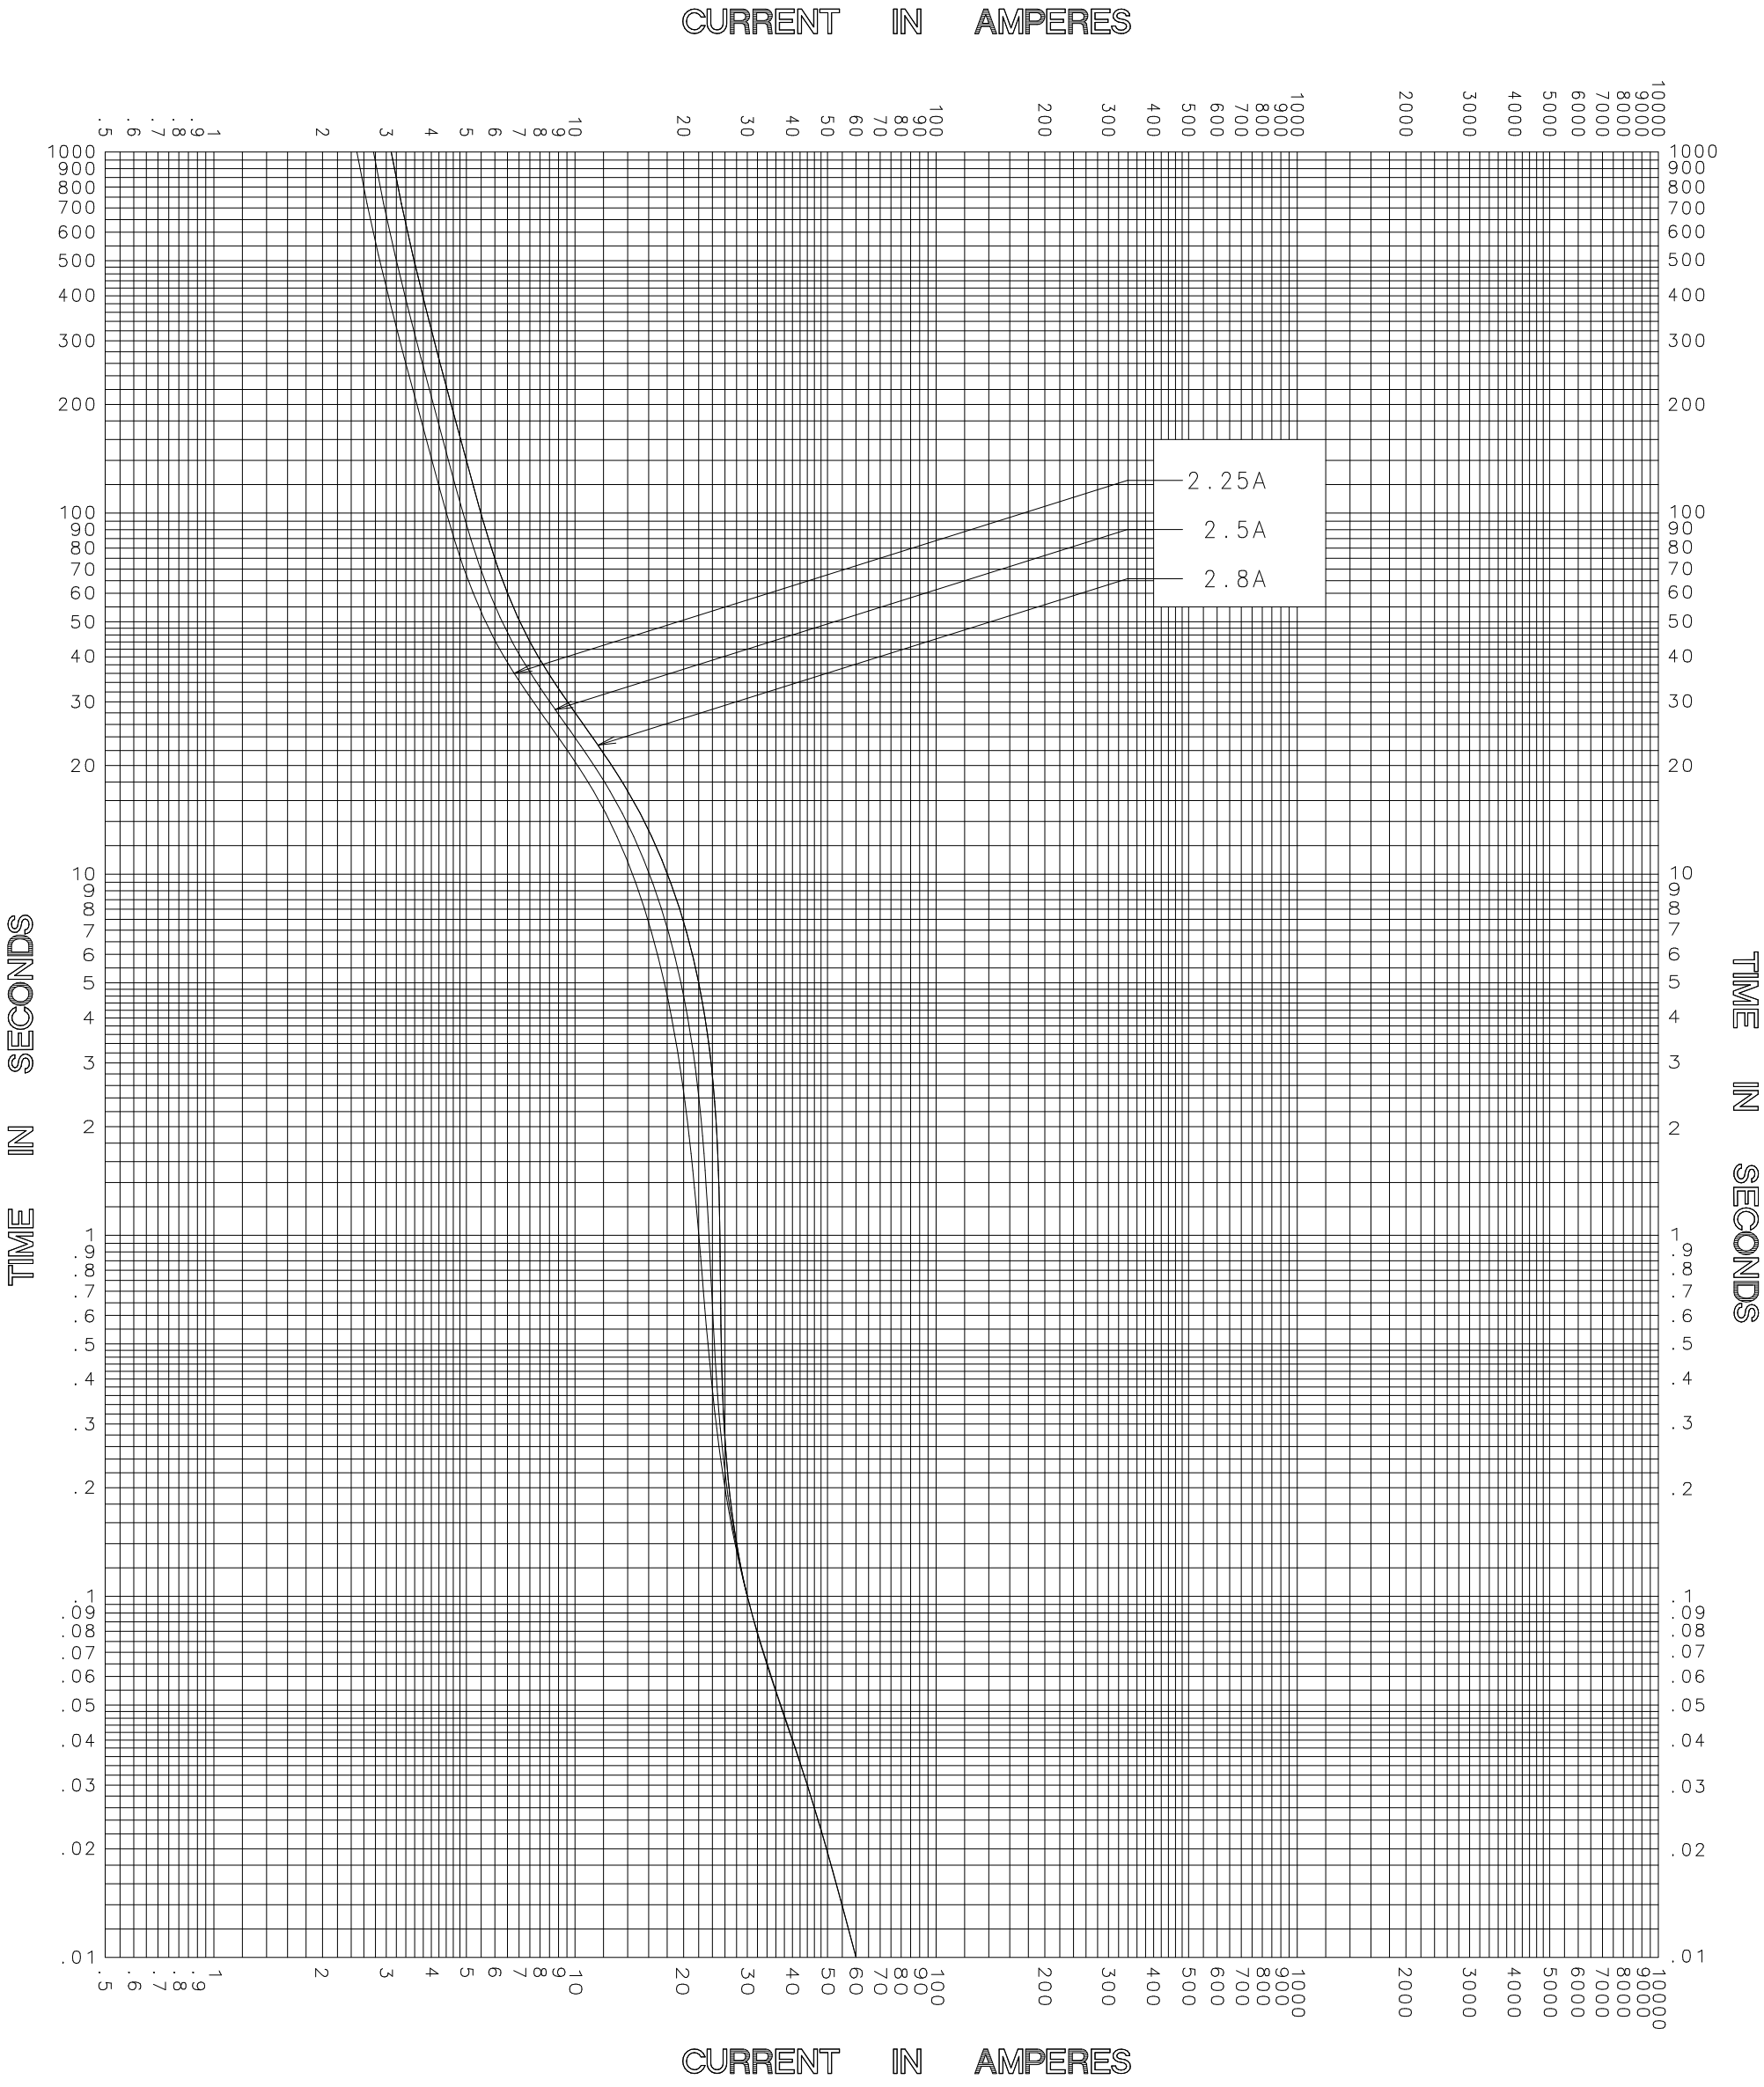

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
LLSRK (2.25A - 2.8A) ID




DRAWN BY LLL
DATE 12/03/04
CHECKED BY MP


TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
B-FCC01-LSRKID-004

-THIS DATA GENERATED ON CAD-

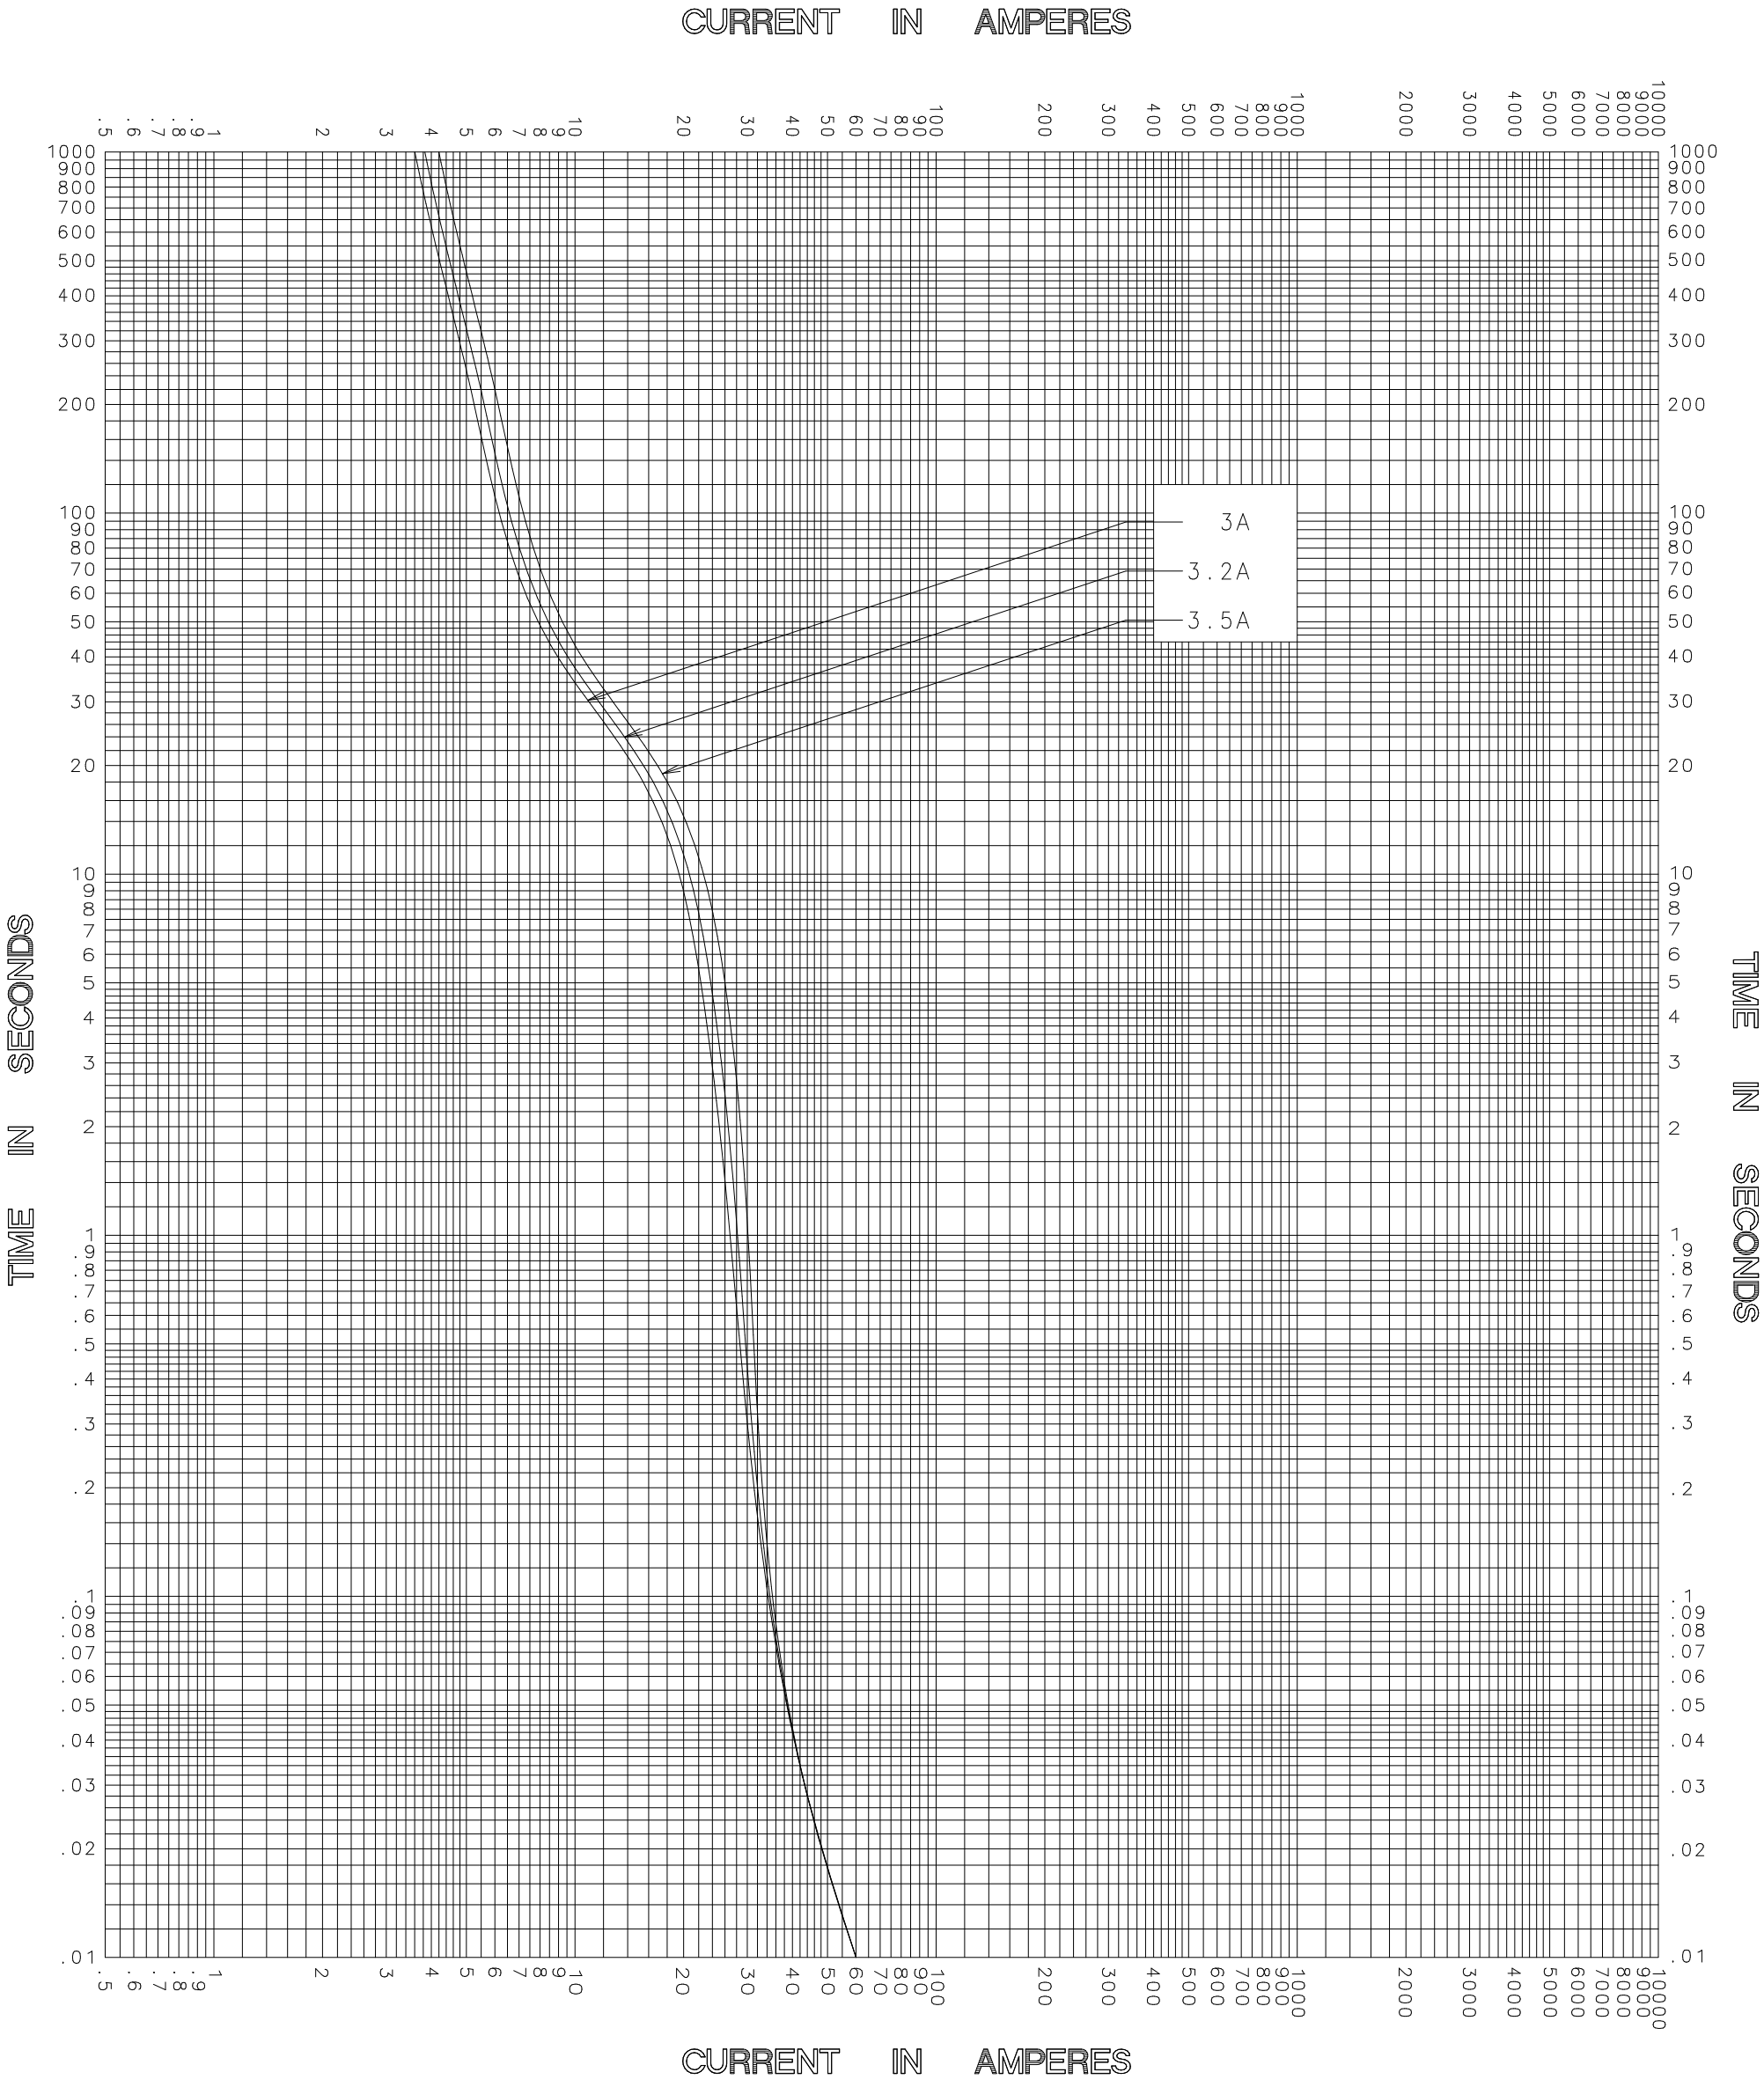

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____	FUSE CATALOG NUMBER LLSRK(3A - 3.5A) ID
 DES PLAINES, ILLINOIS 60016	DRAWN BY <u>LLL</u> DATE <u>12/03/04</u> CHECKED BY <u>MP</u>
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. B-FCC01-LSRKID-005

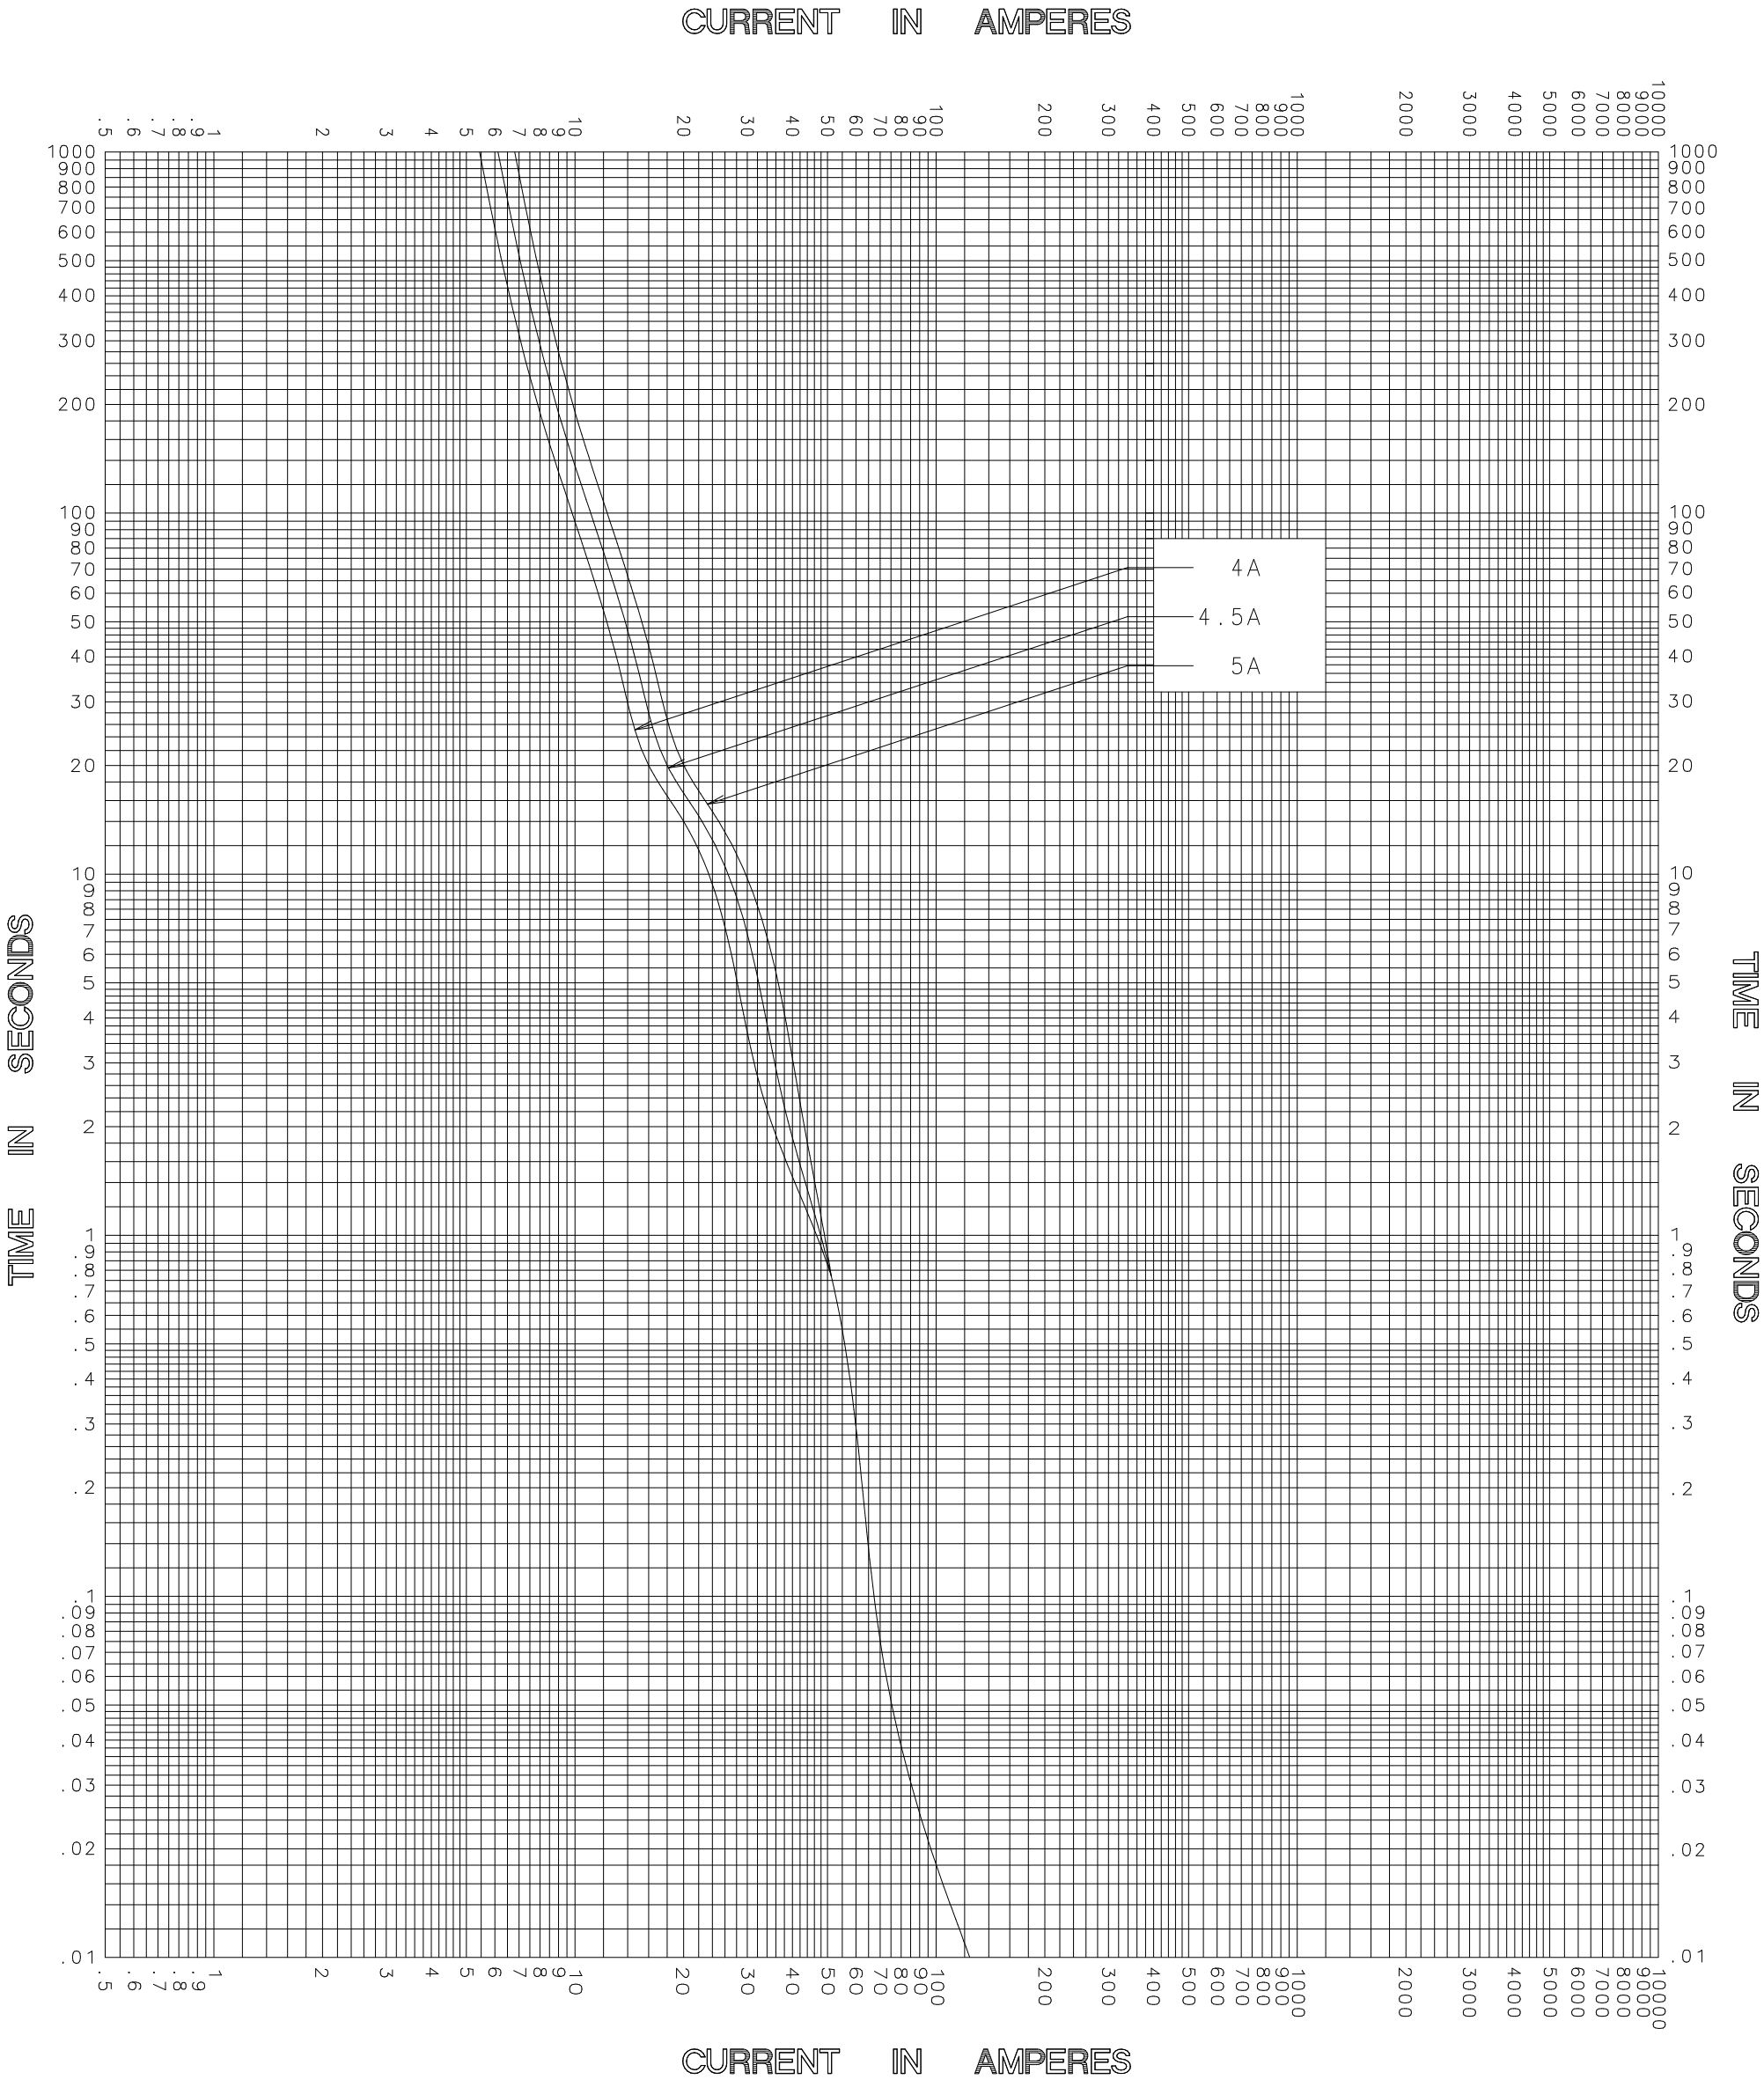

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____


FUSE CATALOG NUMBER
LLSRK (4A - 5A) ID



DRAWN BY LLL
DATE 12/03/04
CHECKED BY MP


TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
B-FCC01-LSRKID-006

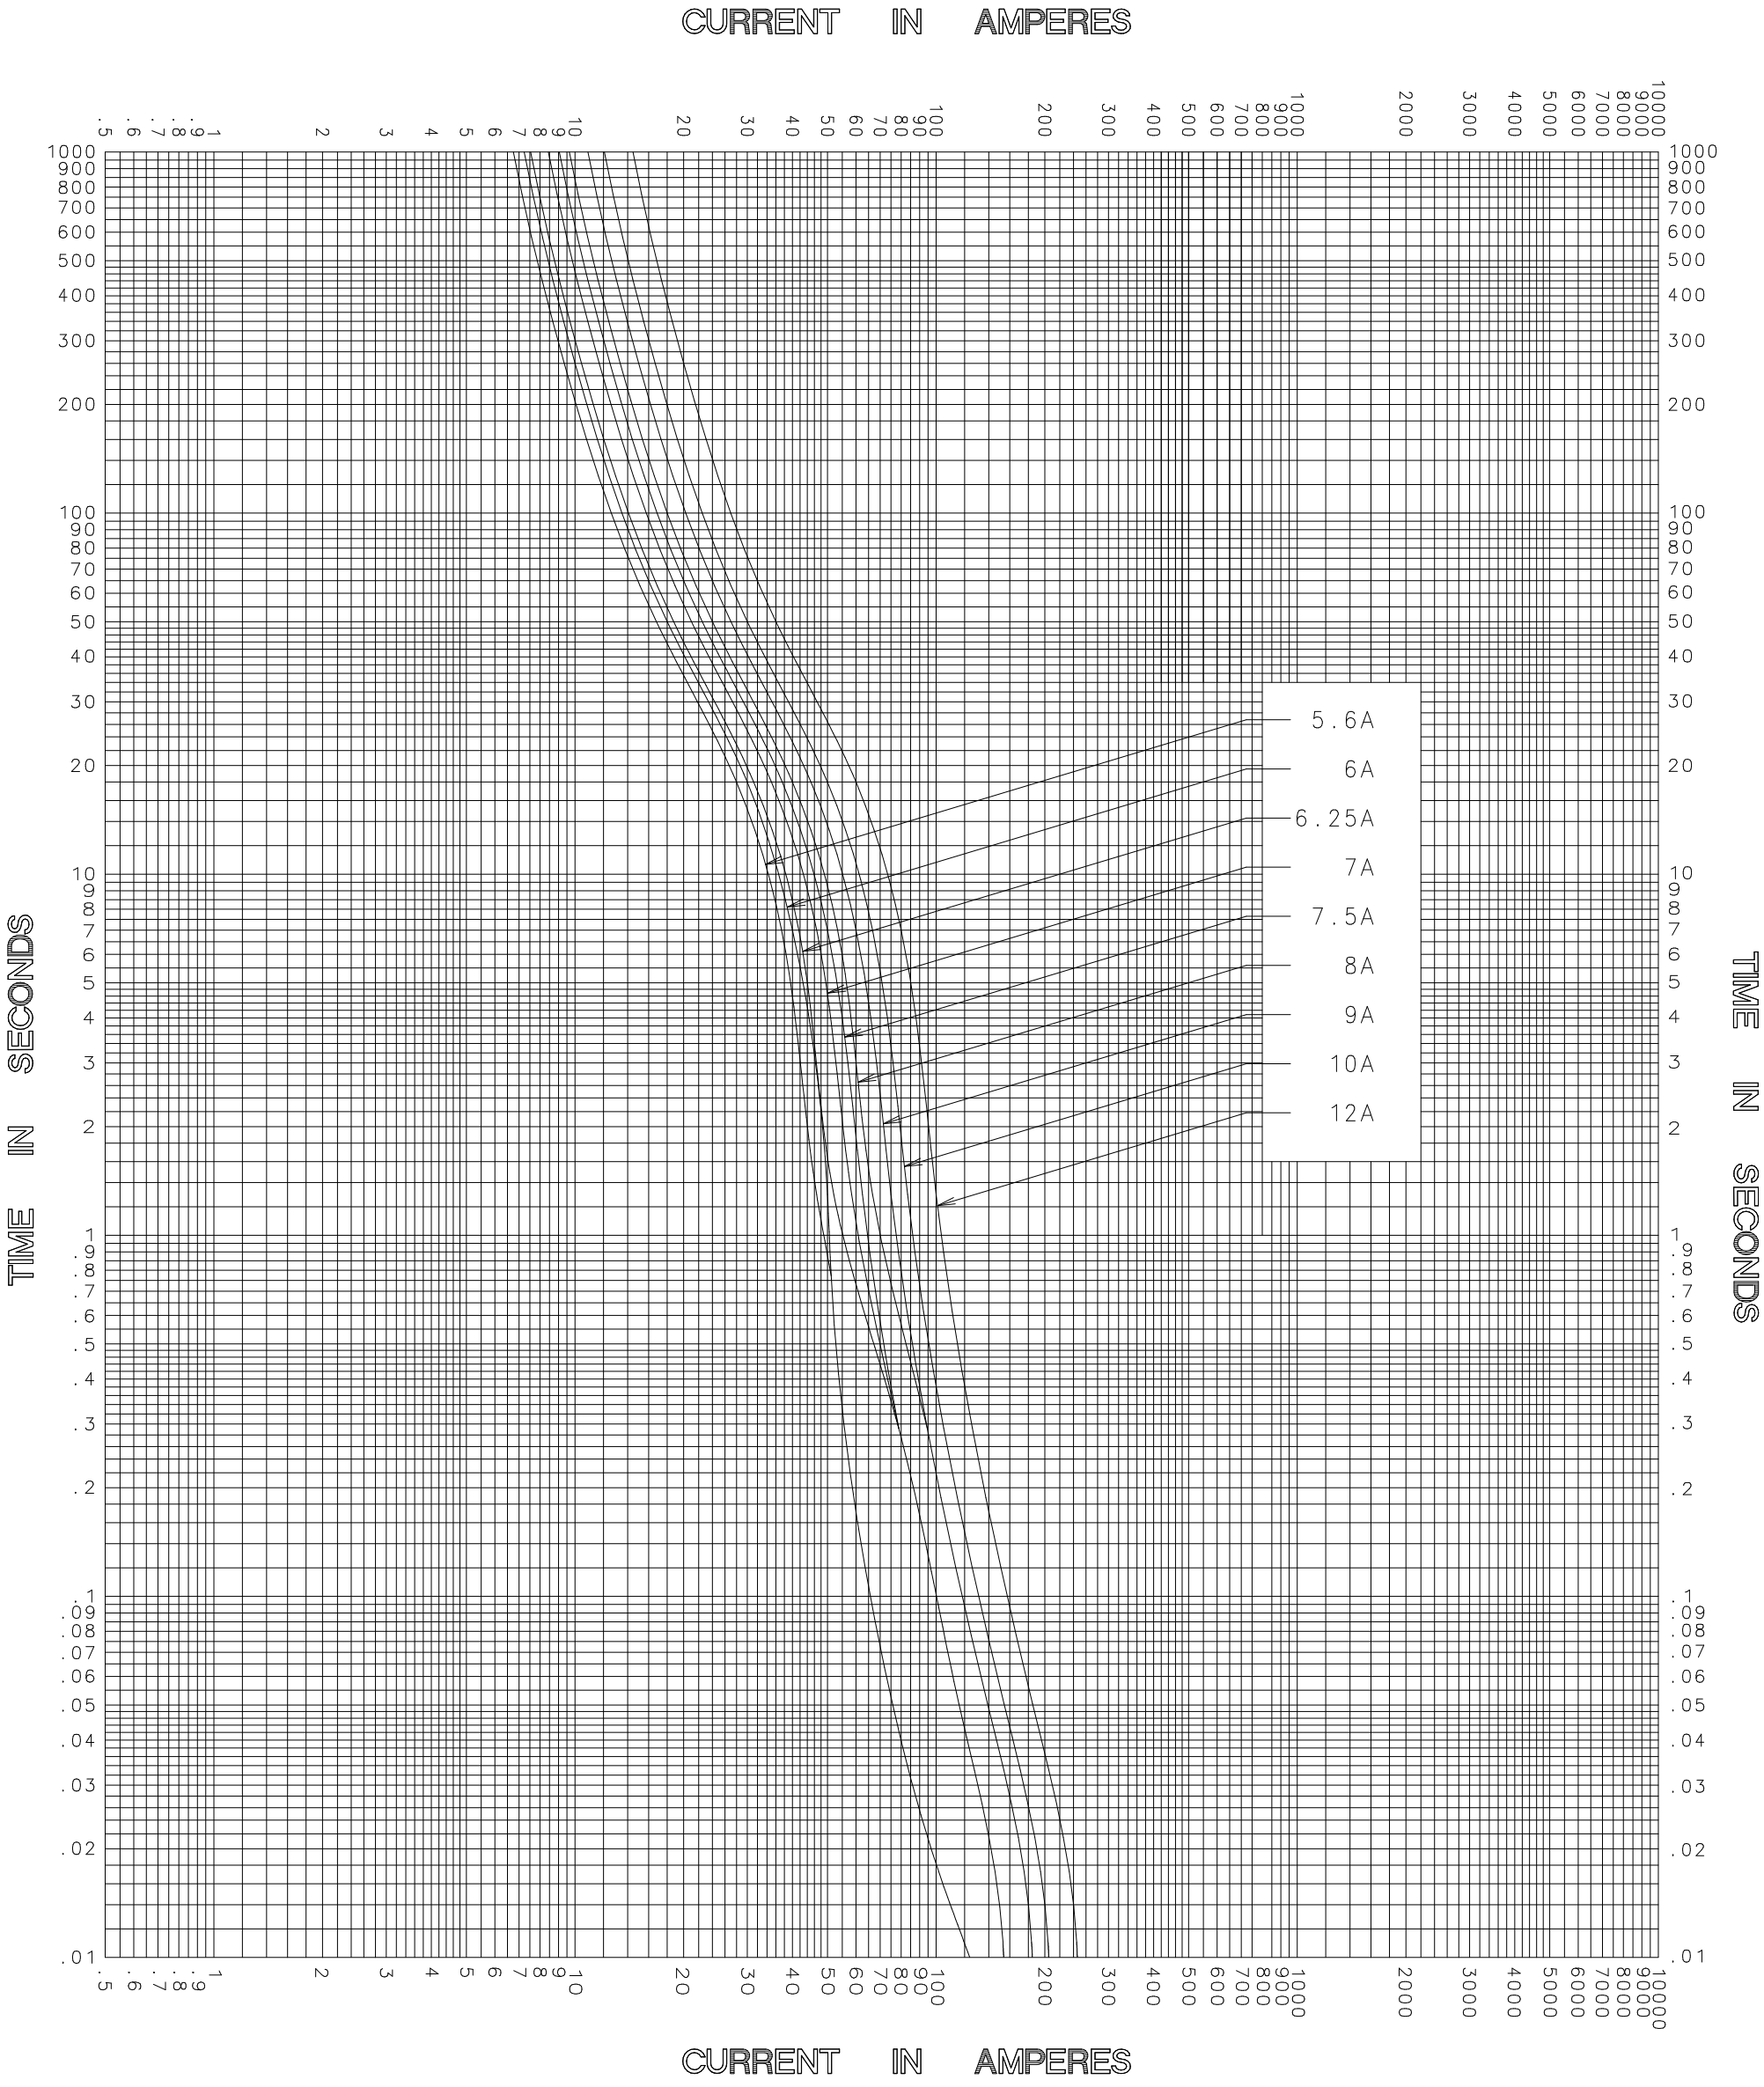

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	LLSRK (5.6A - 12A) ID

 DES PLAINES, ILLINOIS 60016	DRAWN BY <u>LLL</u> DATE <u>12/03/04</u> CHECKED BY <u>MP</u>
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. B-FCC01-LSRKID-007

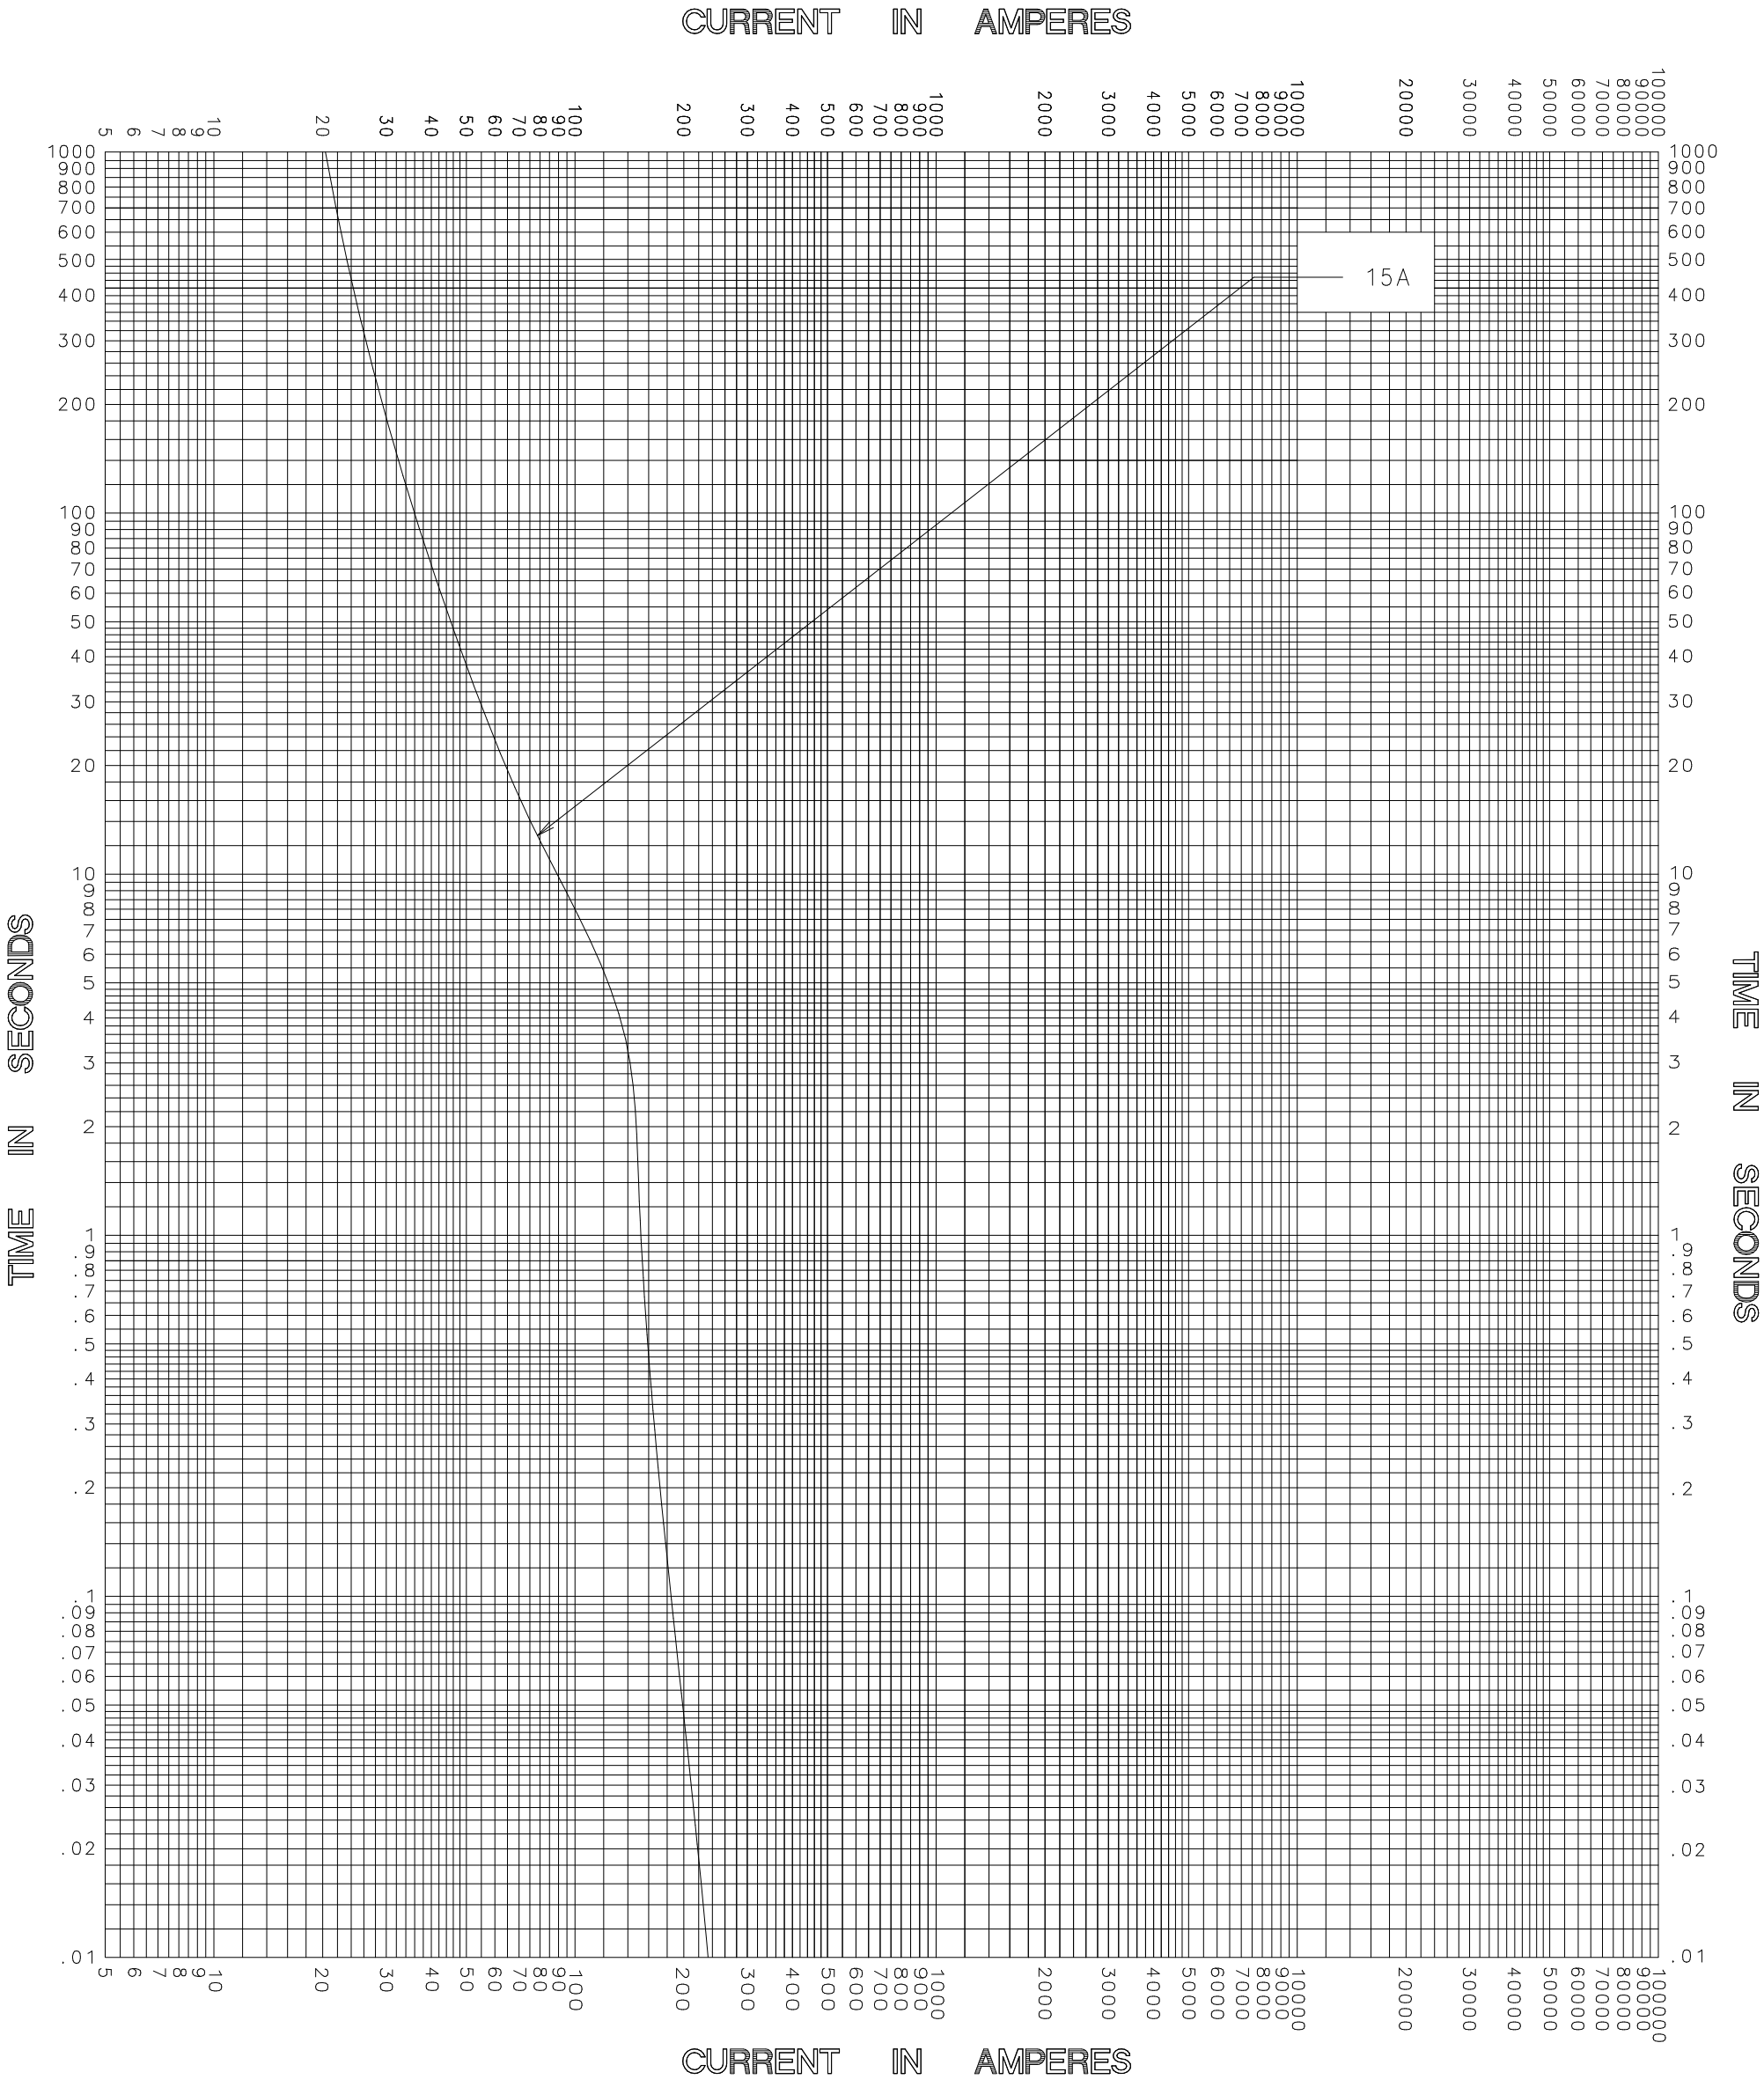


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		LLSRK (15A) ID

 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>12/03/04</u>
TIME CURRENT CHARACTERISTIC CURVES	CHECKED BY <u>MP</u>
	DRAWING NO. <u>B-FCC01-LLSRK/IDN008</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

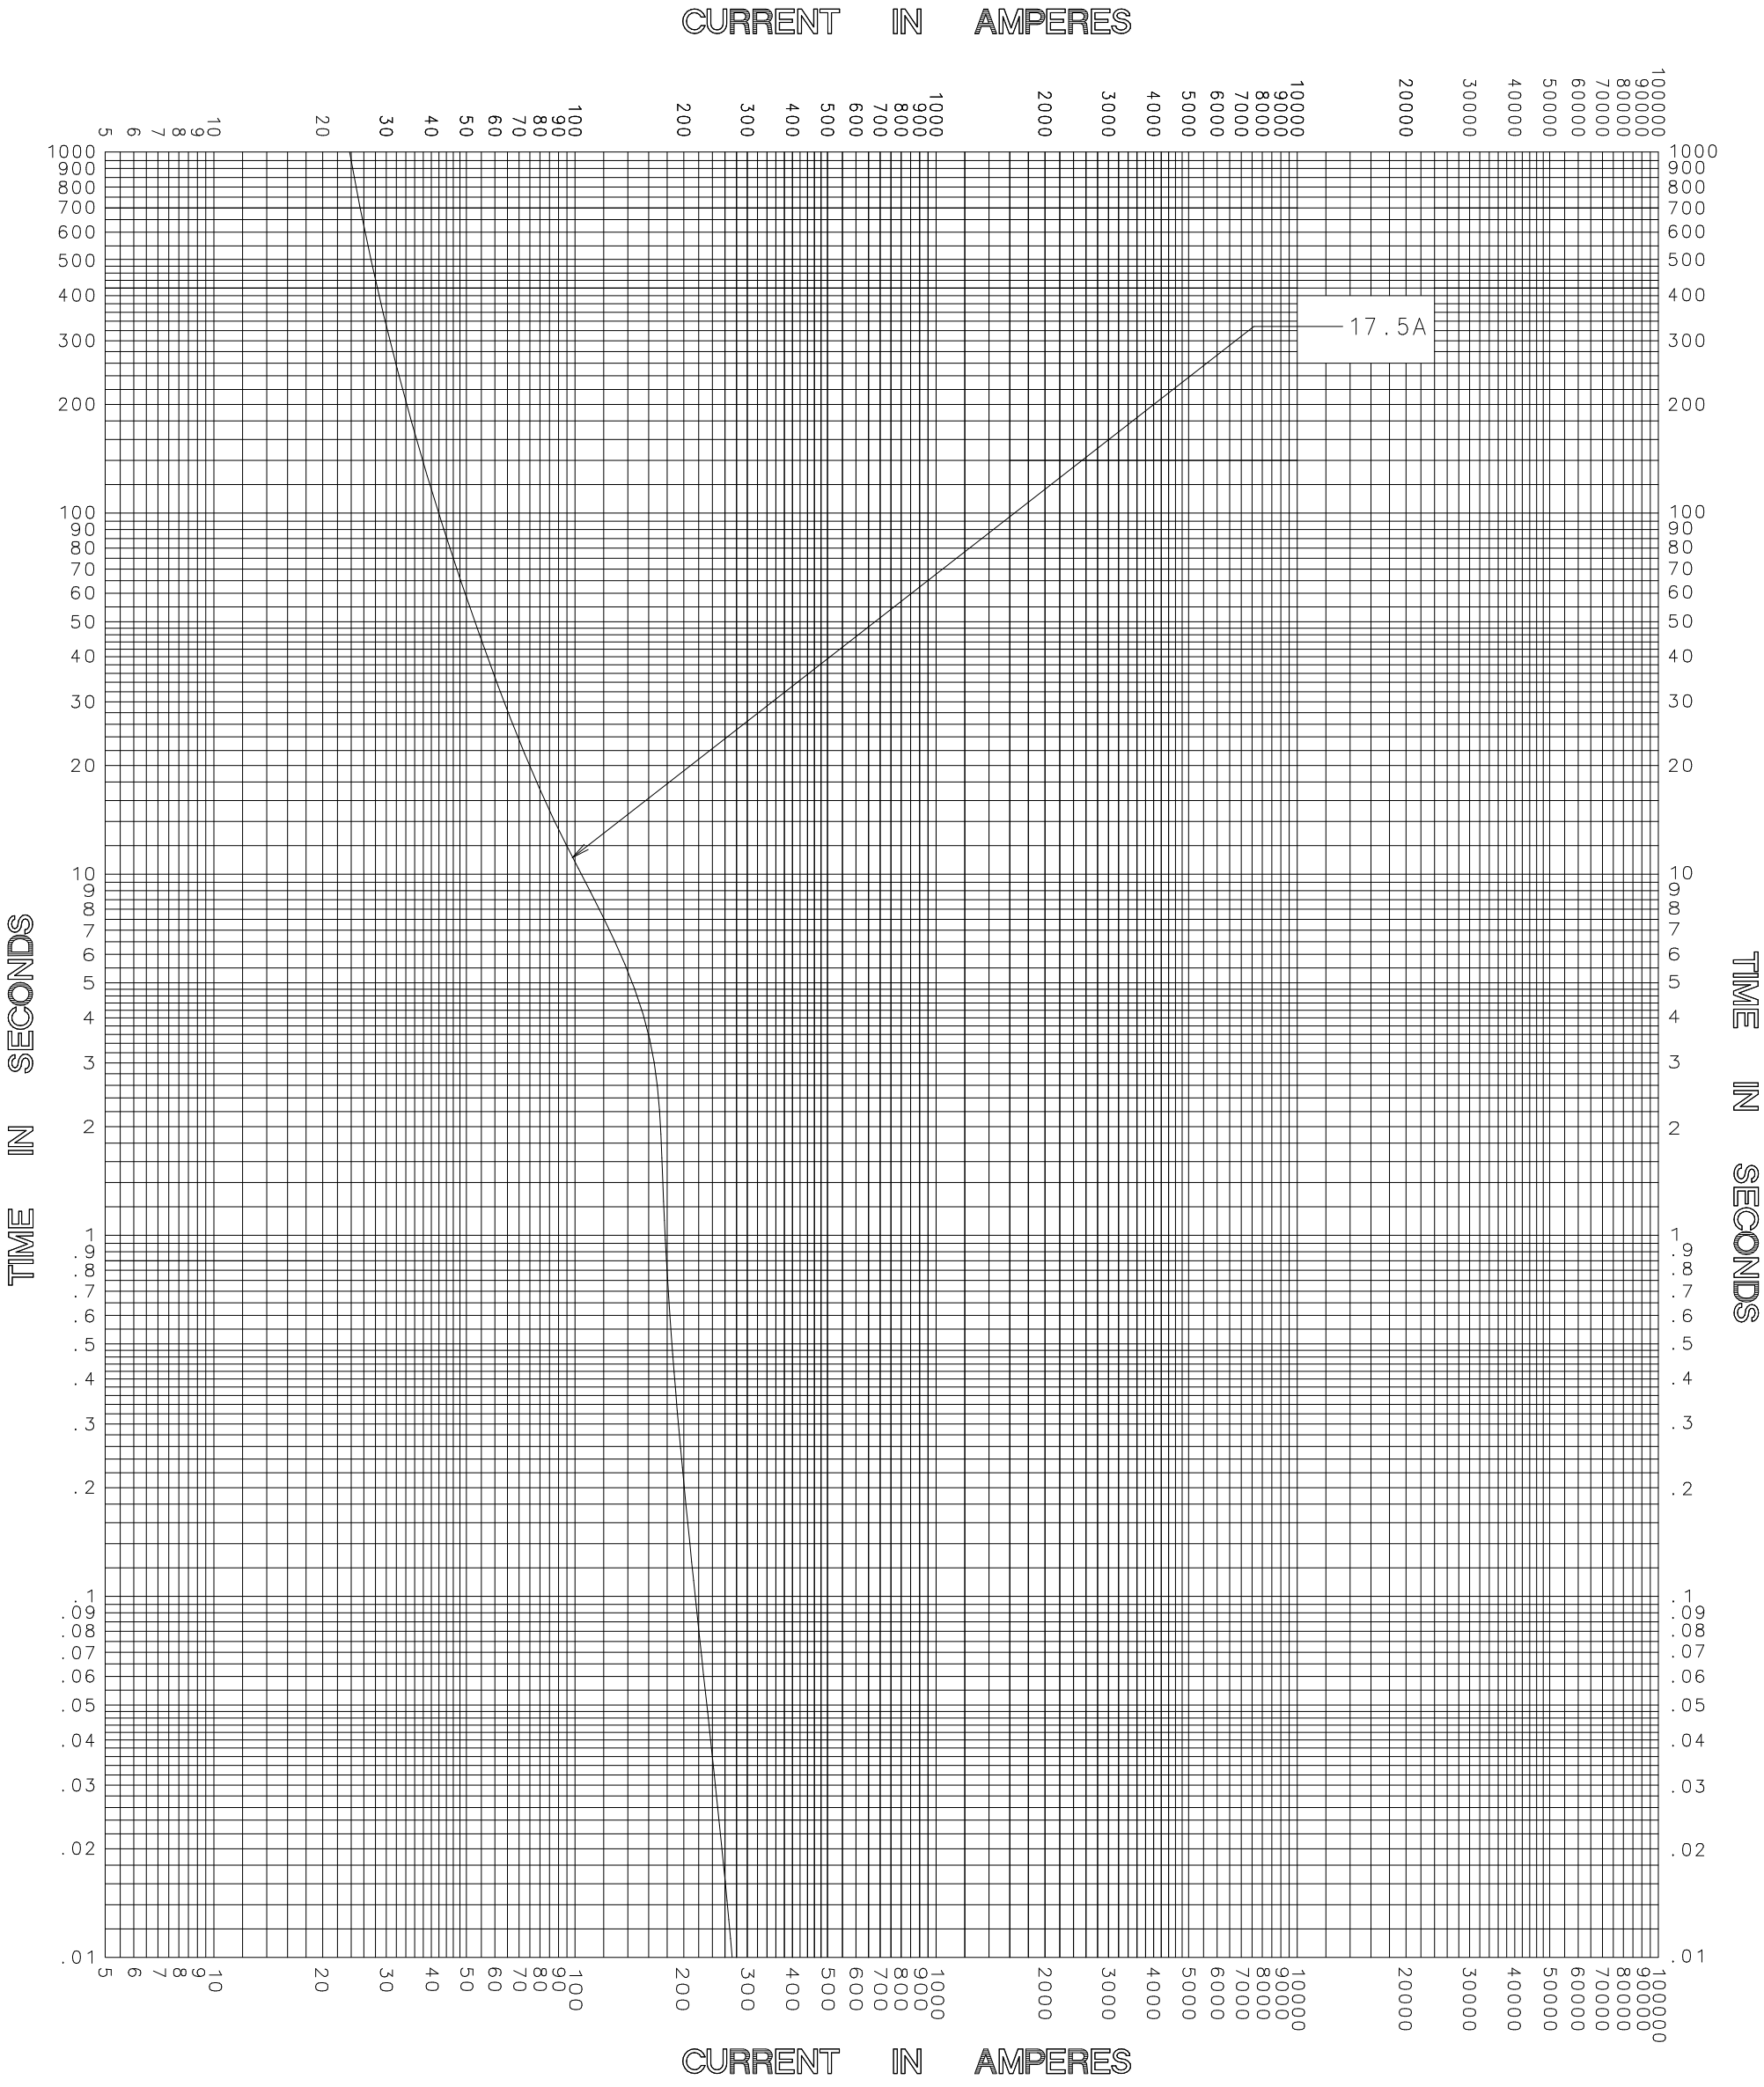


TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	LLSRK (17.5A) ID

 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u> DATE <u>12/03/04</u> CHECKED BY <u>MP</u>
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. B-FCC01-LLSRK/IDN009

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

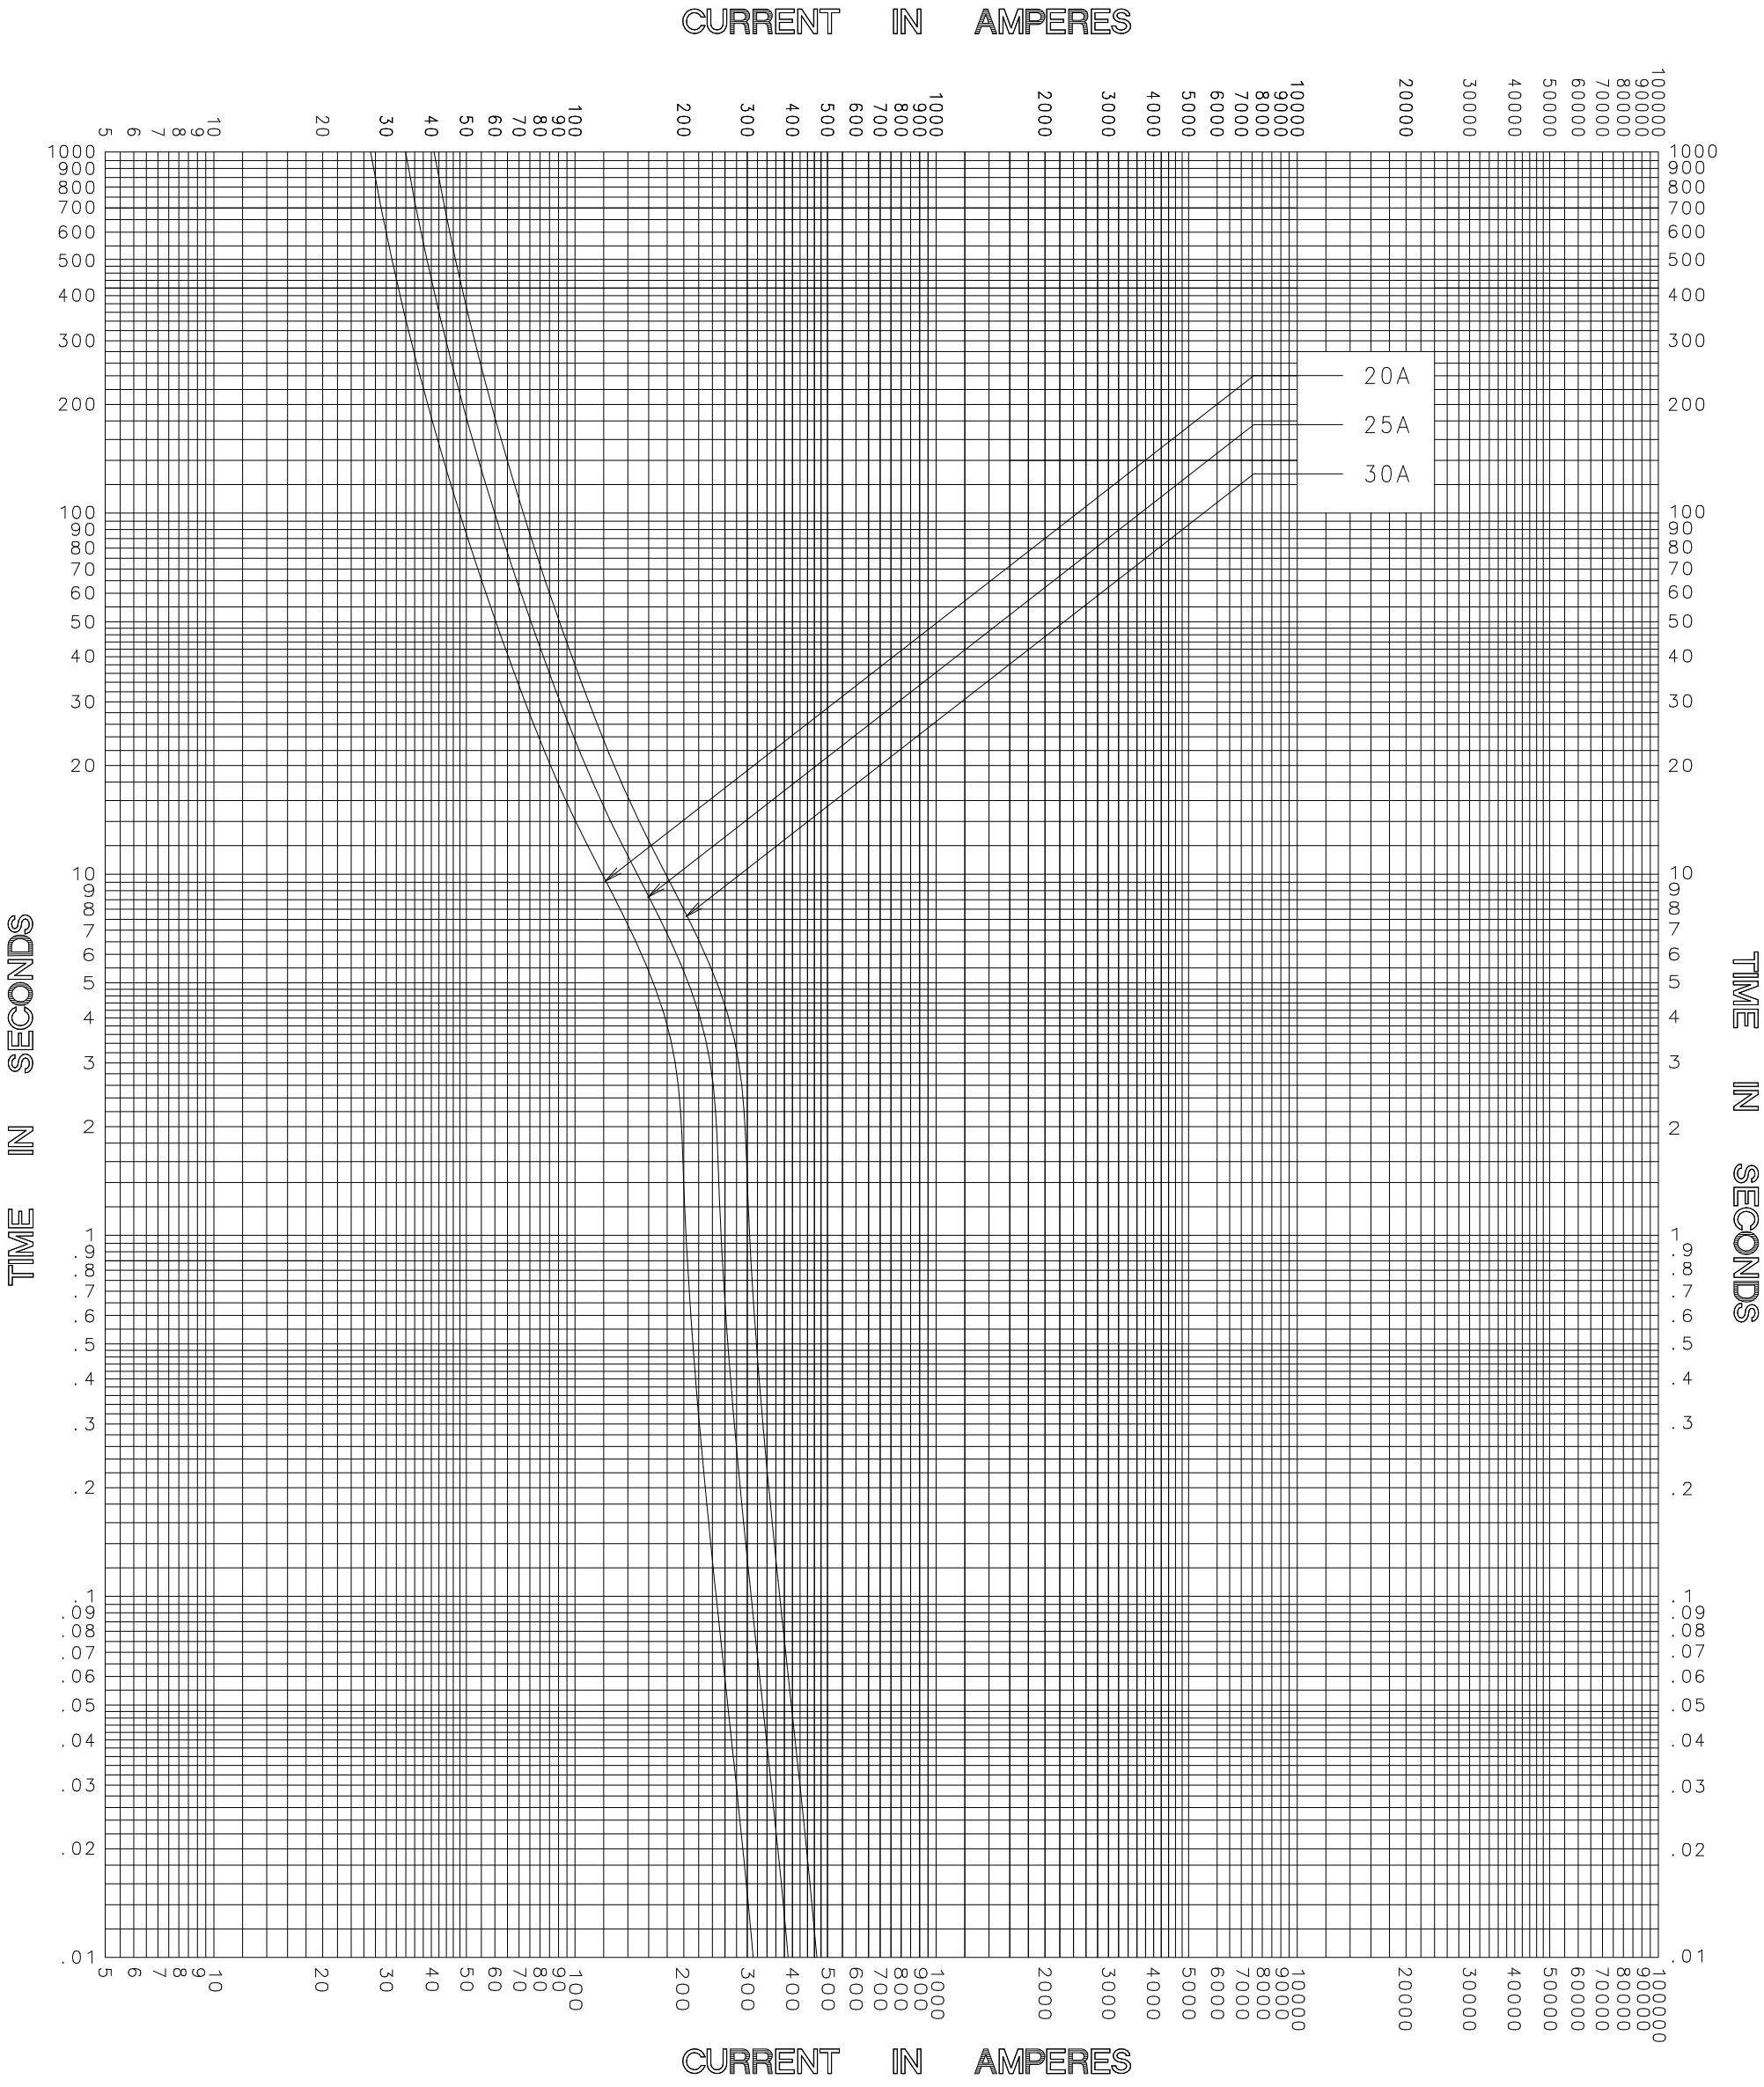


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		LLSRK (20A - 30A) ID

 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>12/03/04</u>
TIME CURRENT CHARACTERISTIC CURVES	CHECKED BY <u>MP</u>
	DRAWING NO. <u>B-FCC01-SRK/ID 010</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

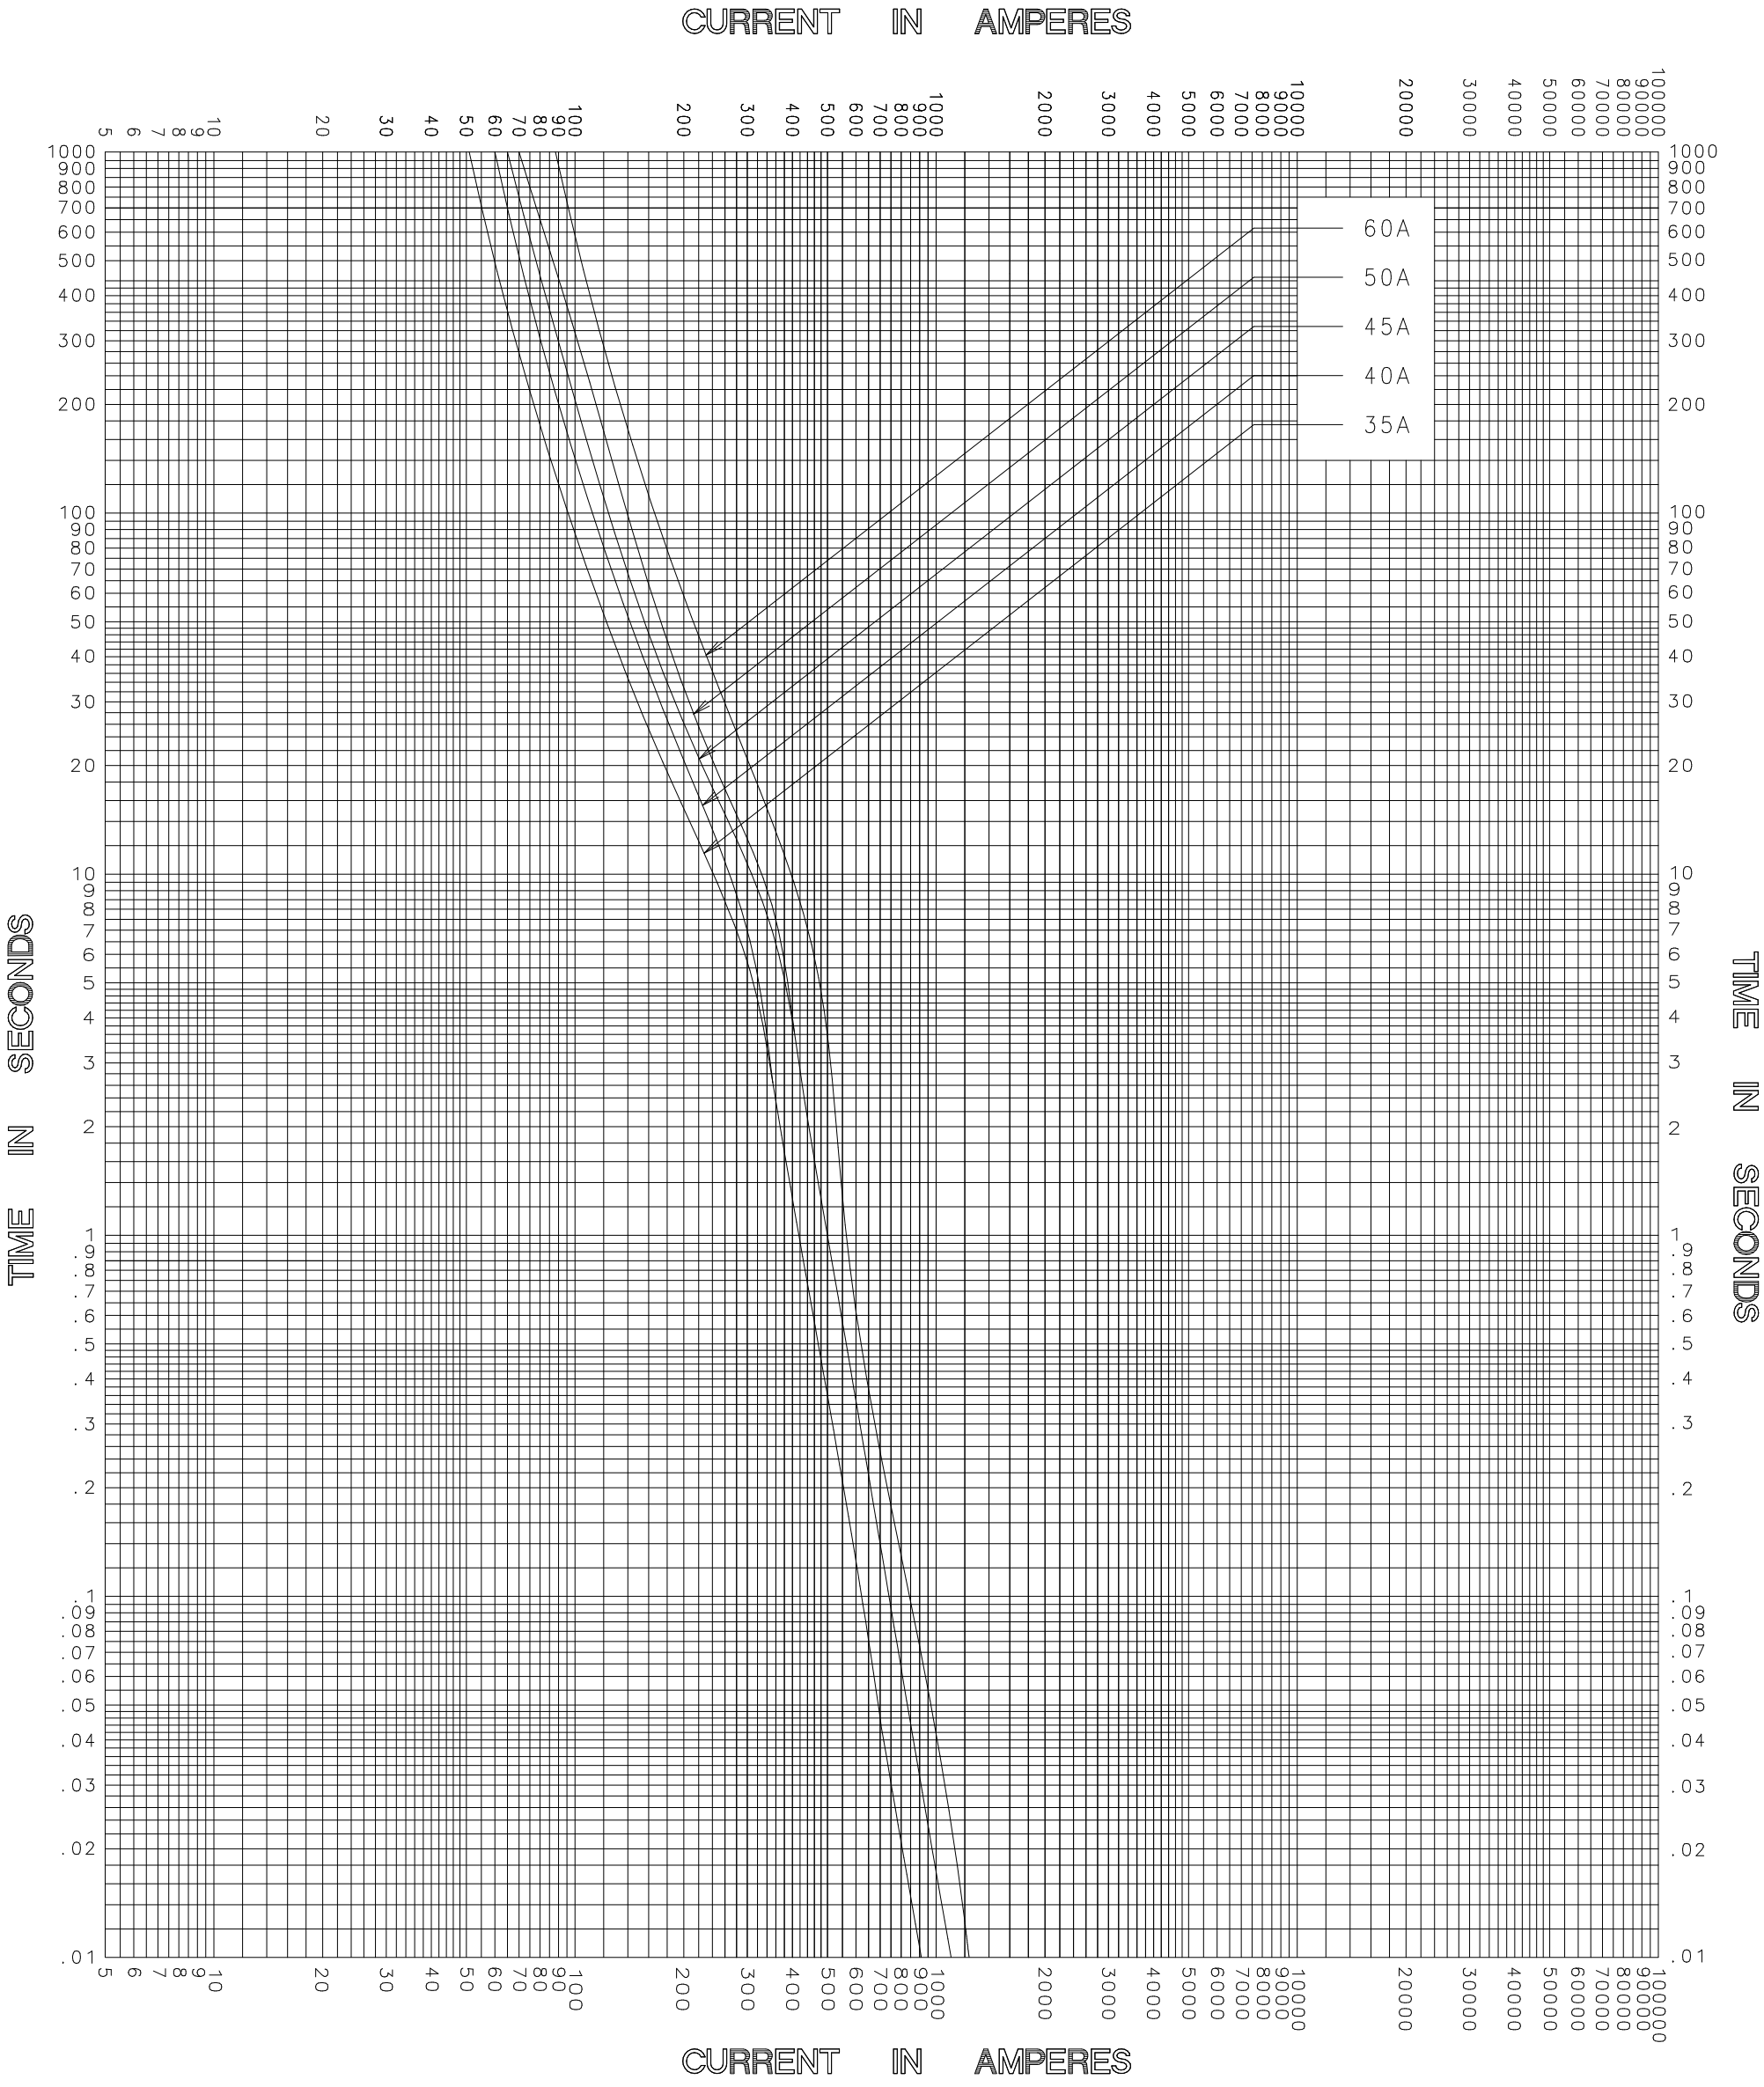

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
LLSRK (35A - 60A) ID



LITTELFUSE, INC.
DES PLAINES, ILL. USA


DRAWN BY LLL
DATE 12/03/04
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES


DRAWING NO.
B-FCC01-SRK/ID 011

-THIS DATA GENERATED ON CAD-


UNCONTROLLED
DOCUMENT

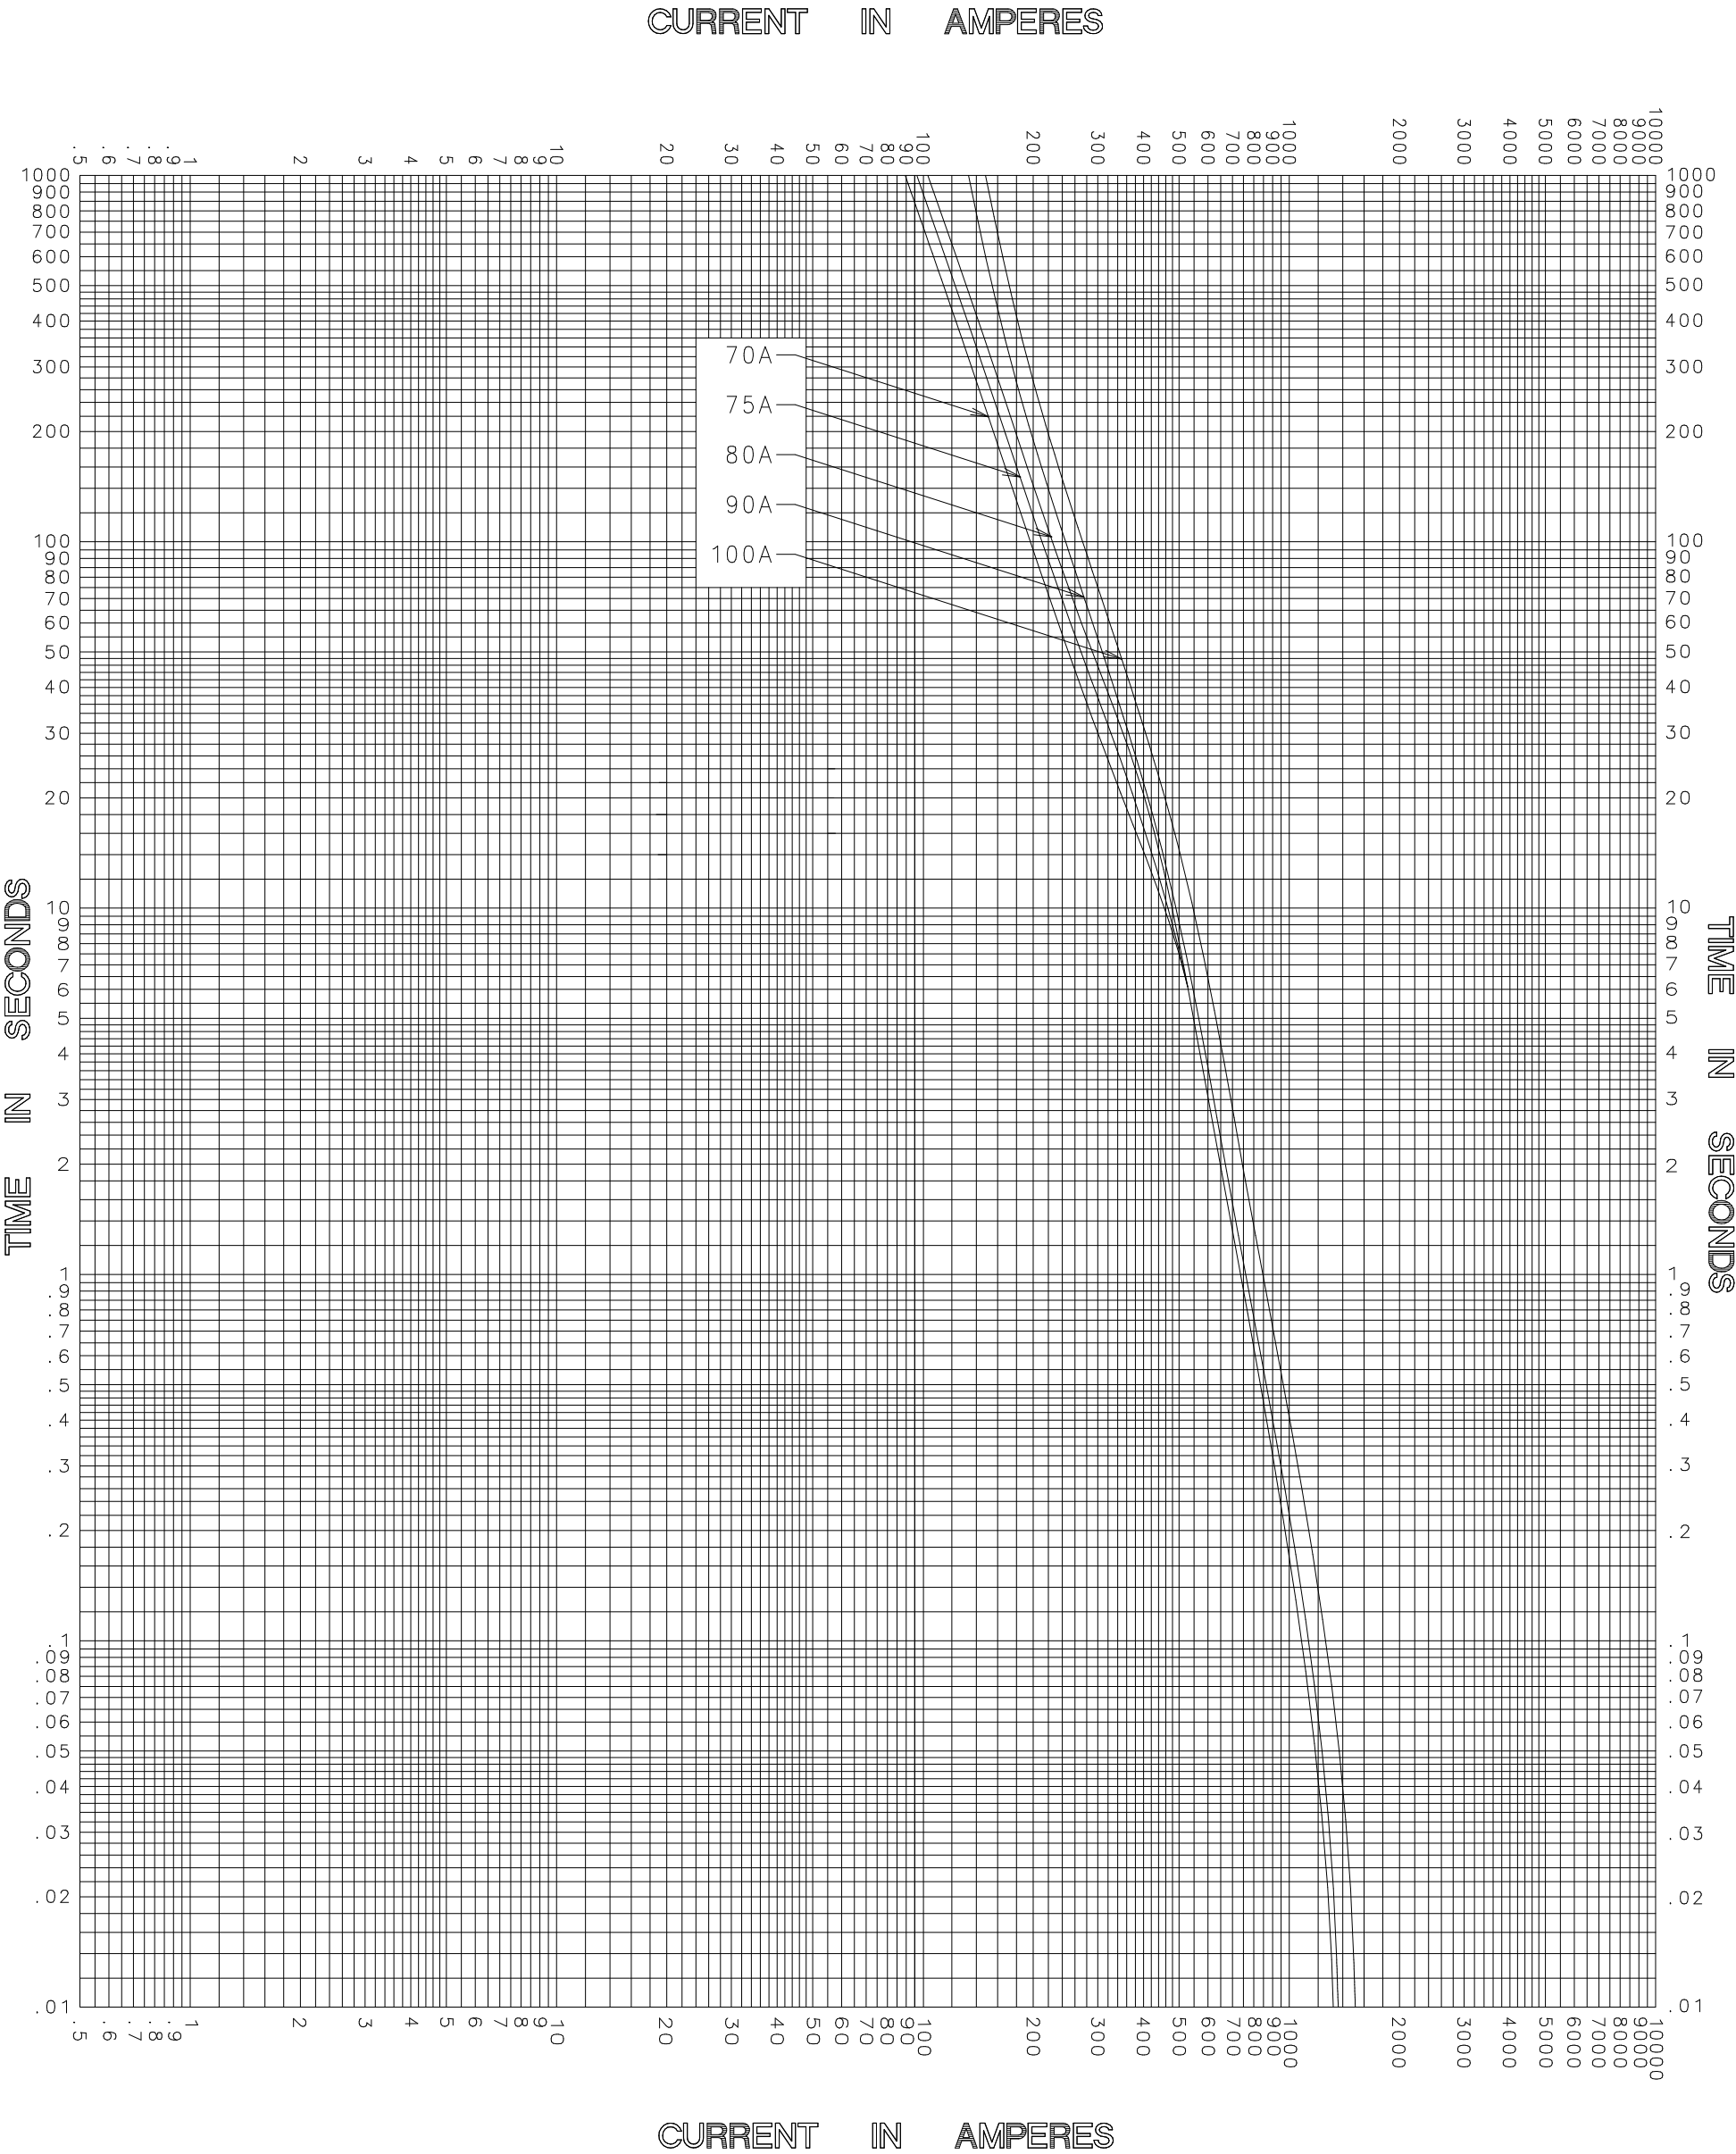

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		LLSRK (70A - 100A) ID

 DES PLAINES, ILLINOIS 60016	DRAWN BY <u>LLL</u> DATE <u>12/03/04</u> CHECKED BY <u>MP</u>
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. <u>B-FCC01-LSRK-5-100</u>

UNCONTROLLED
DOCUMENT

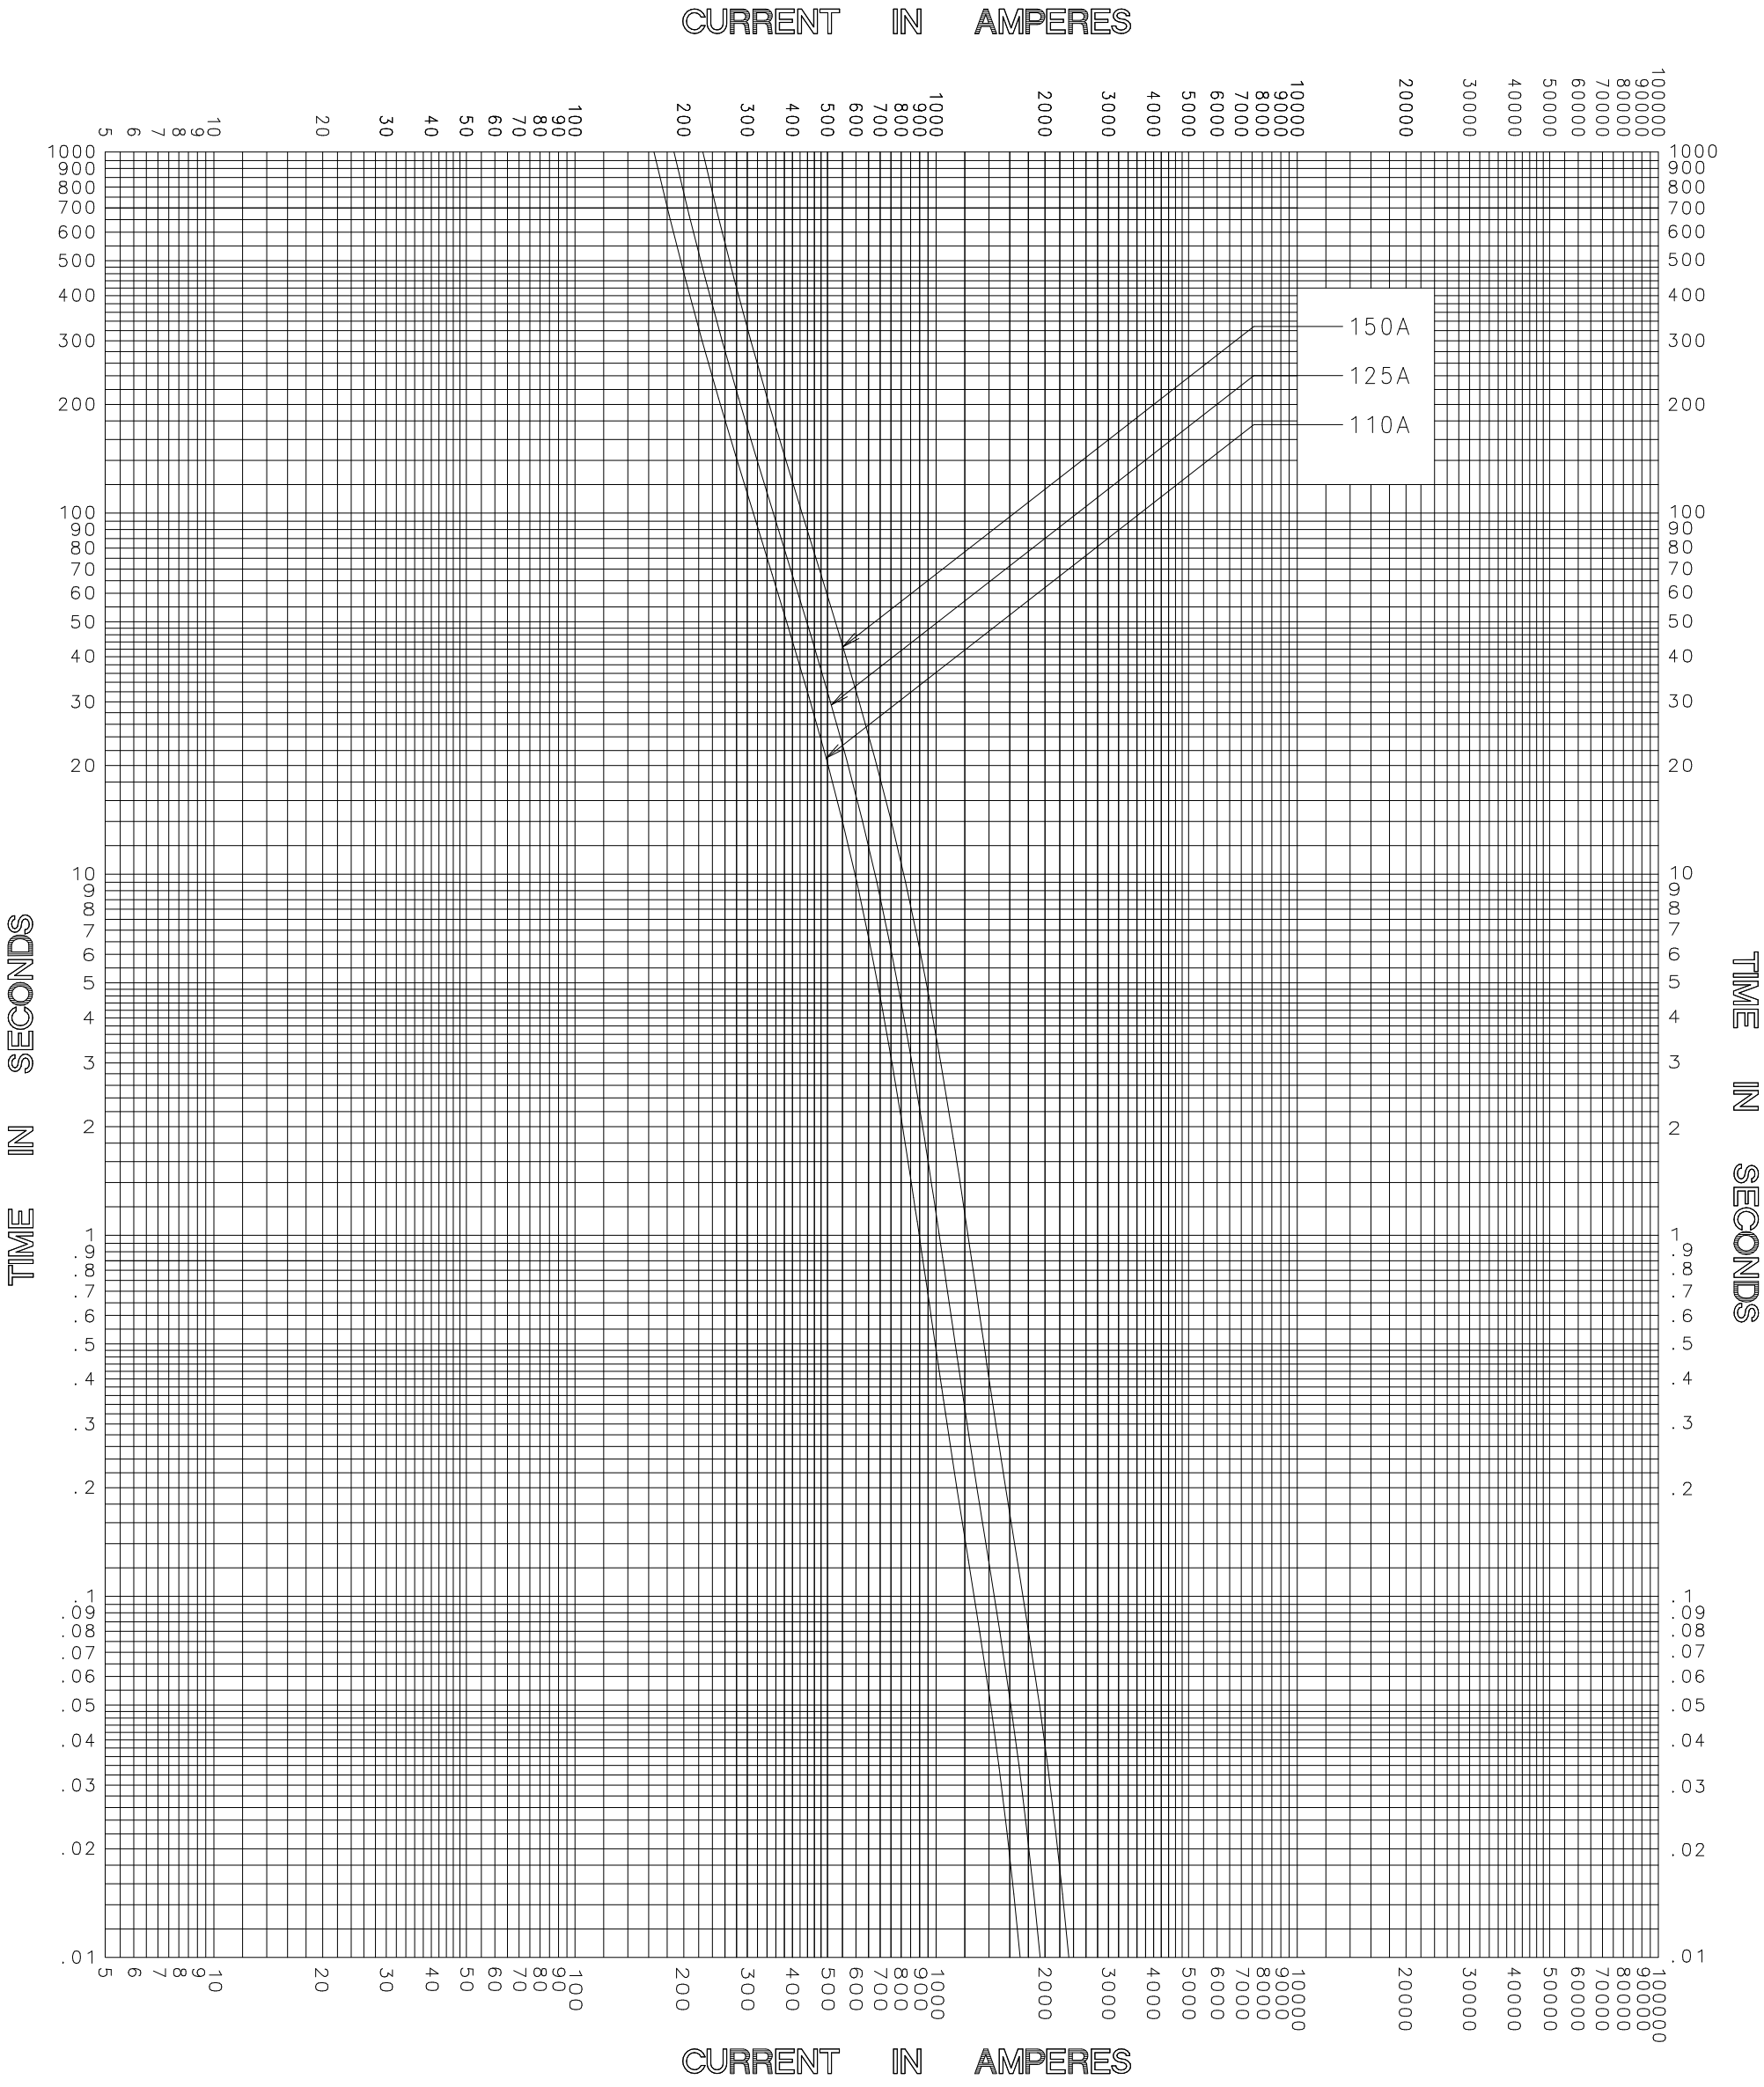


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		LLSRK (110A - 150A) ID

 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>12/03/04</u>
TIME CURRENT CHARACTERISTIC CURVES	CHECKED BY <u>MP</u>
	DRAWING NO. <u>B-FCC01-SRK/IDN013</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

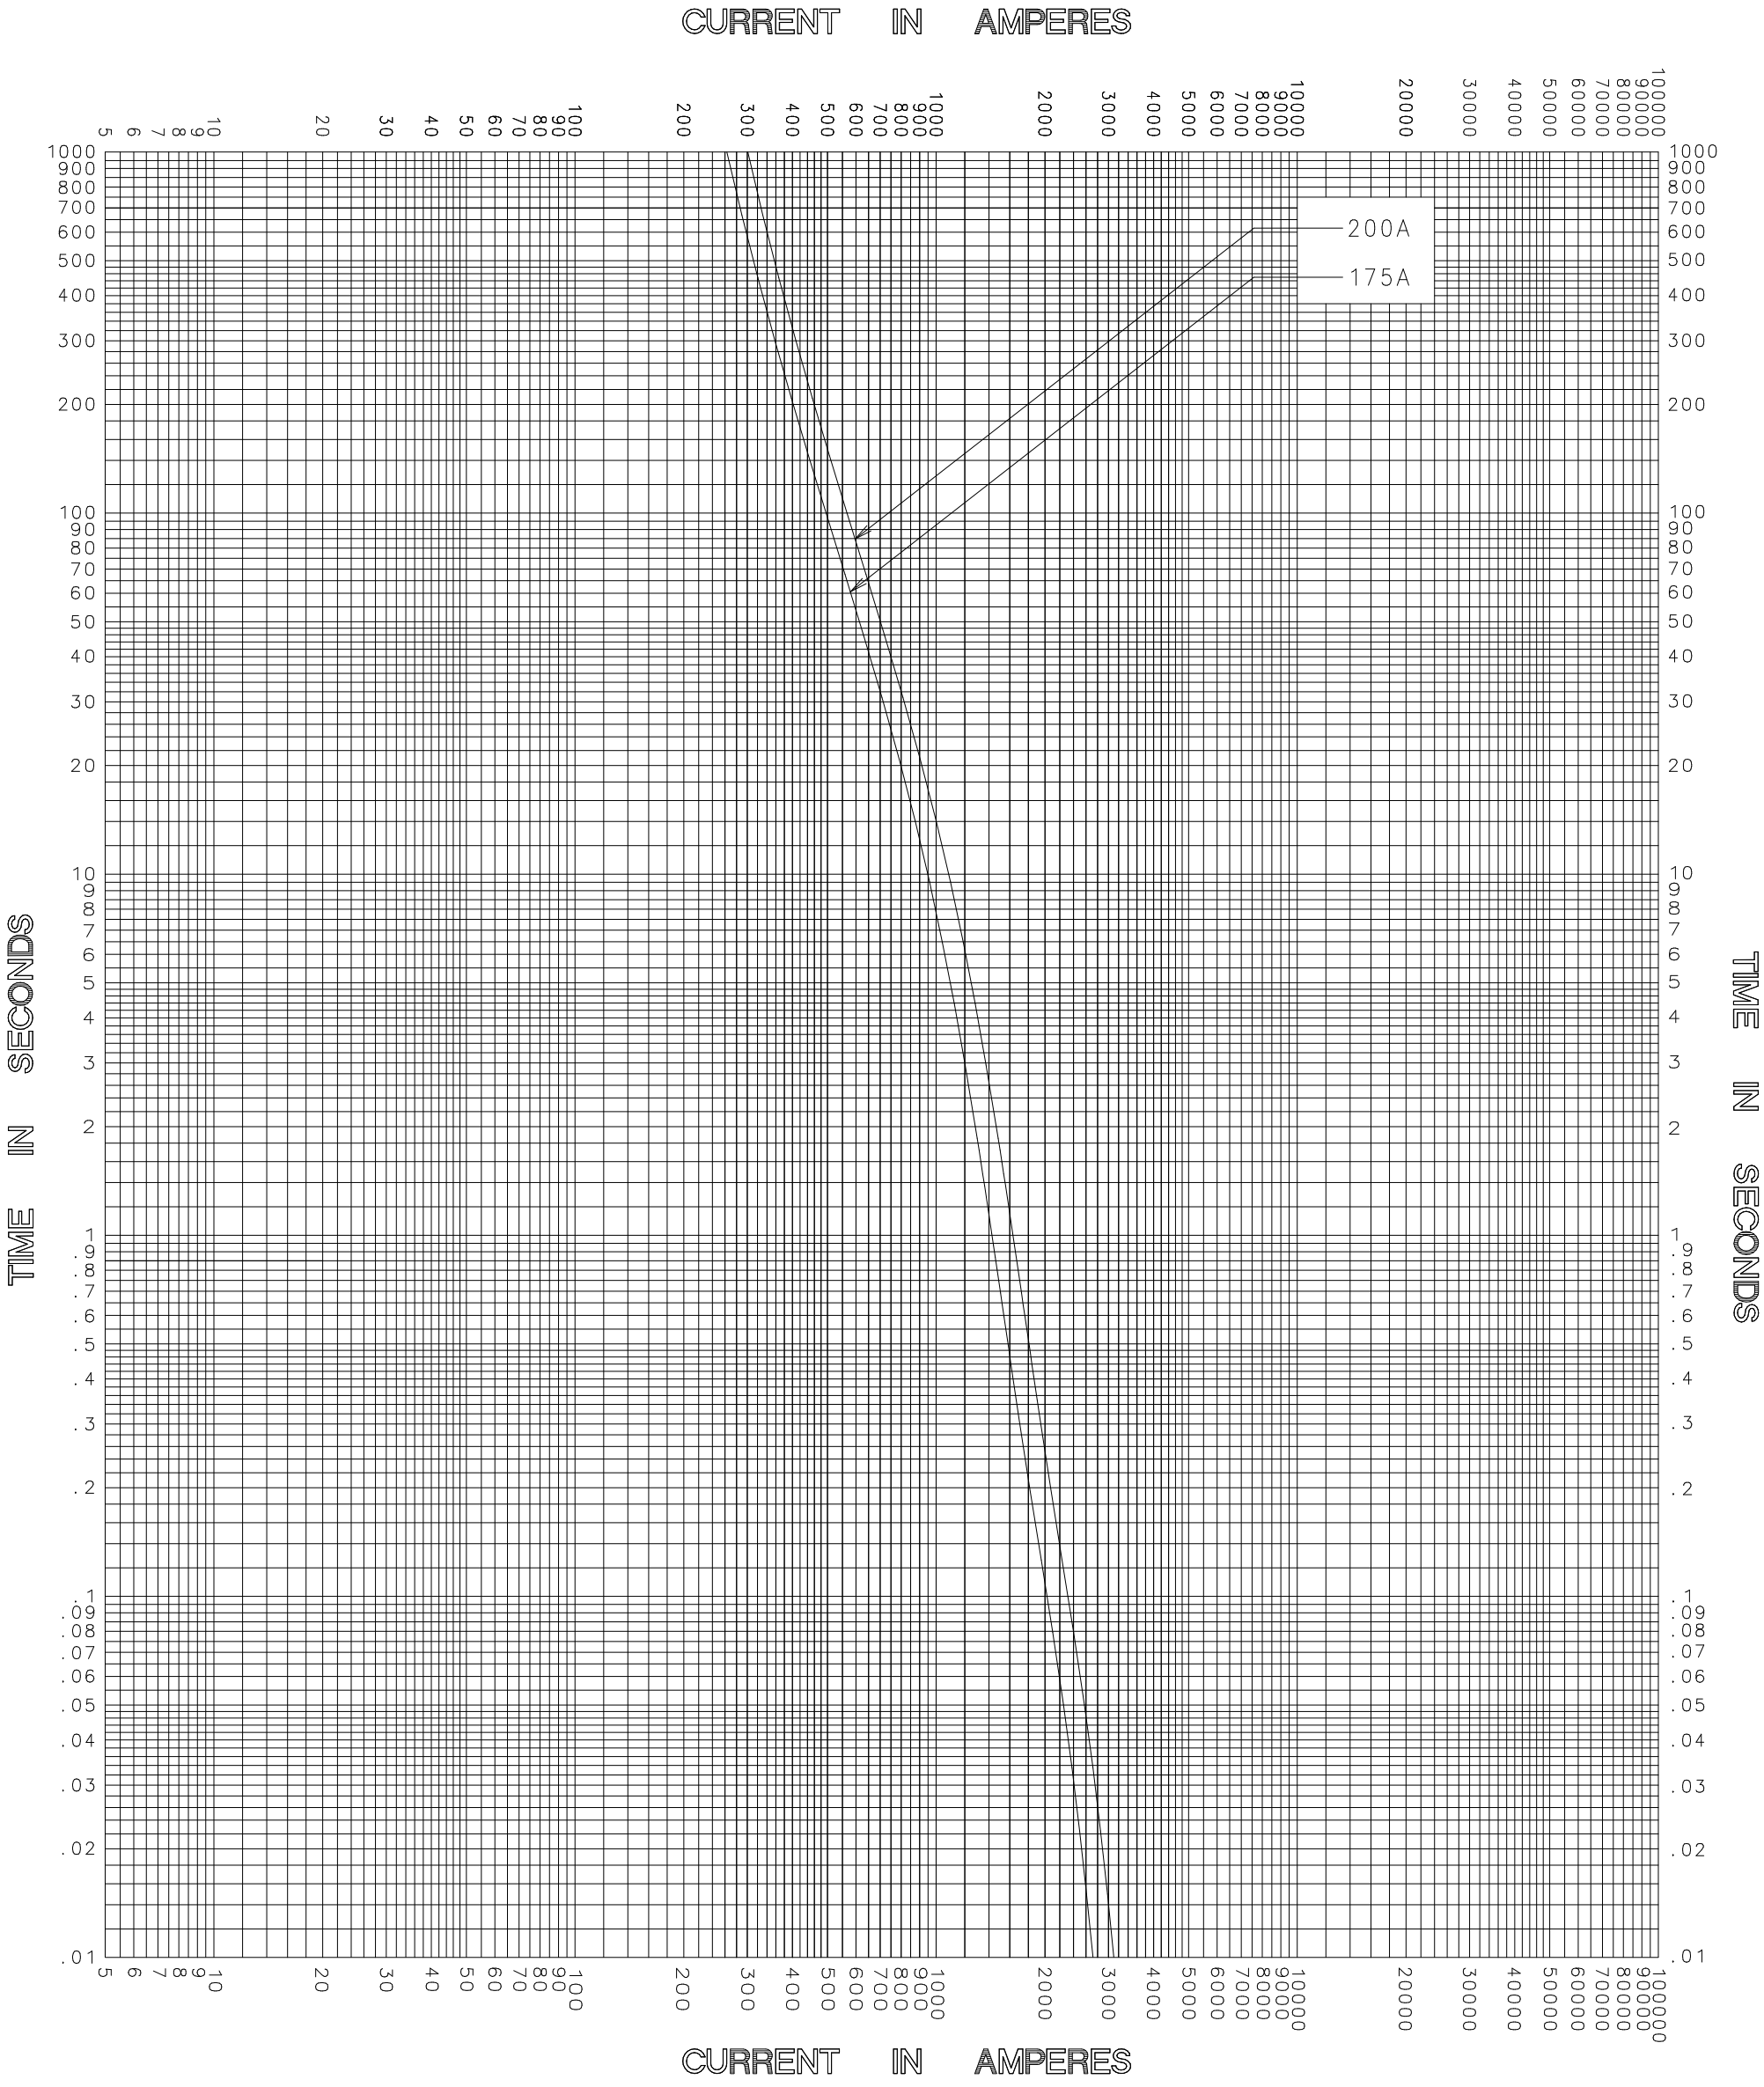


TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	LLSRK (175A - 200A) ID

 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u> DATE <u>12/03/04</u> CHECKED BY <u>MP</u>
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. <u>B-FCC01-SRK/JUN 014</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

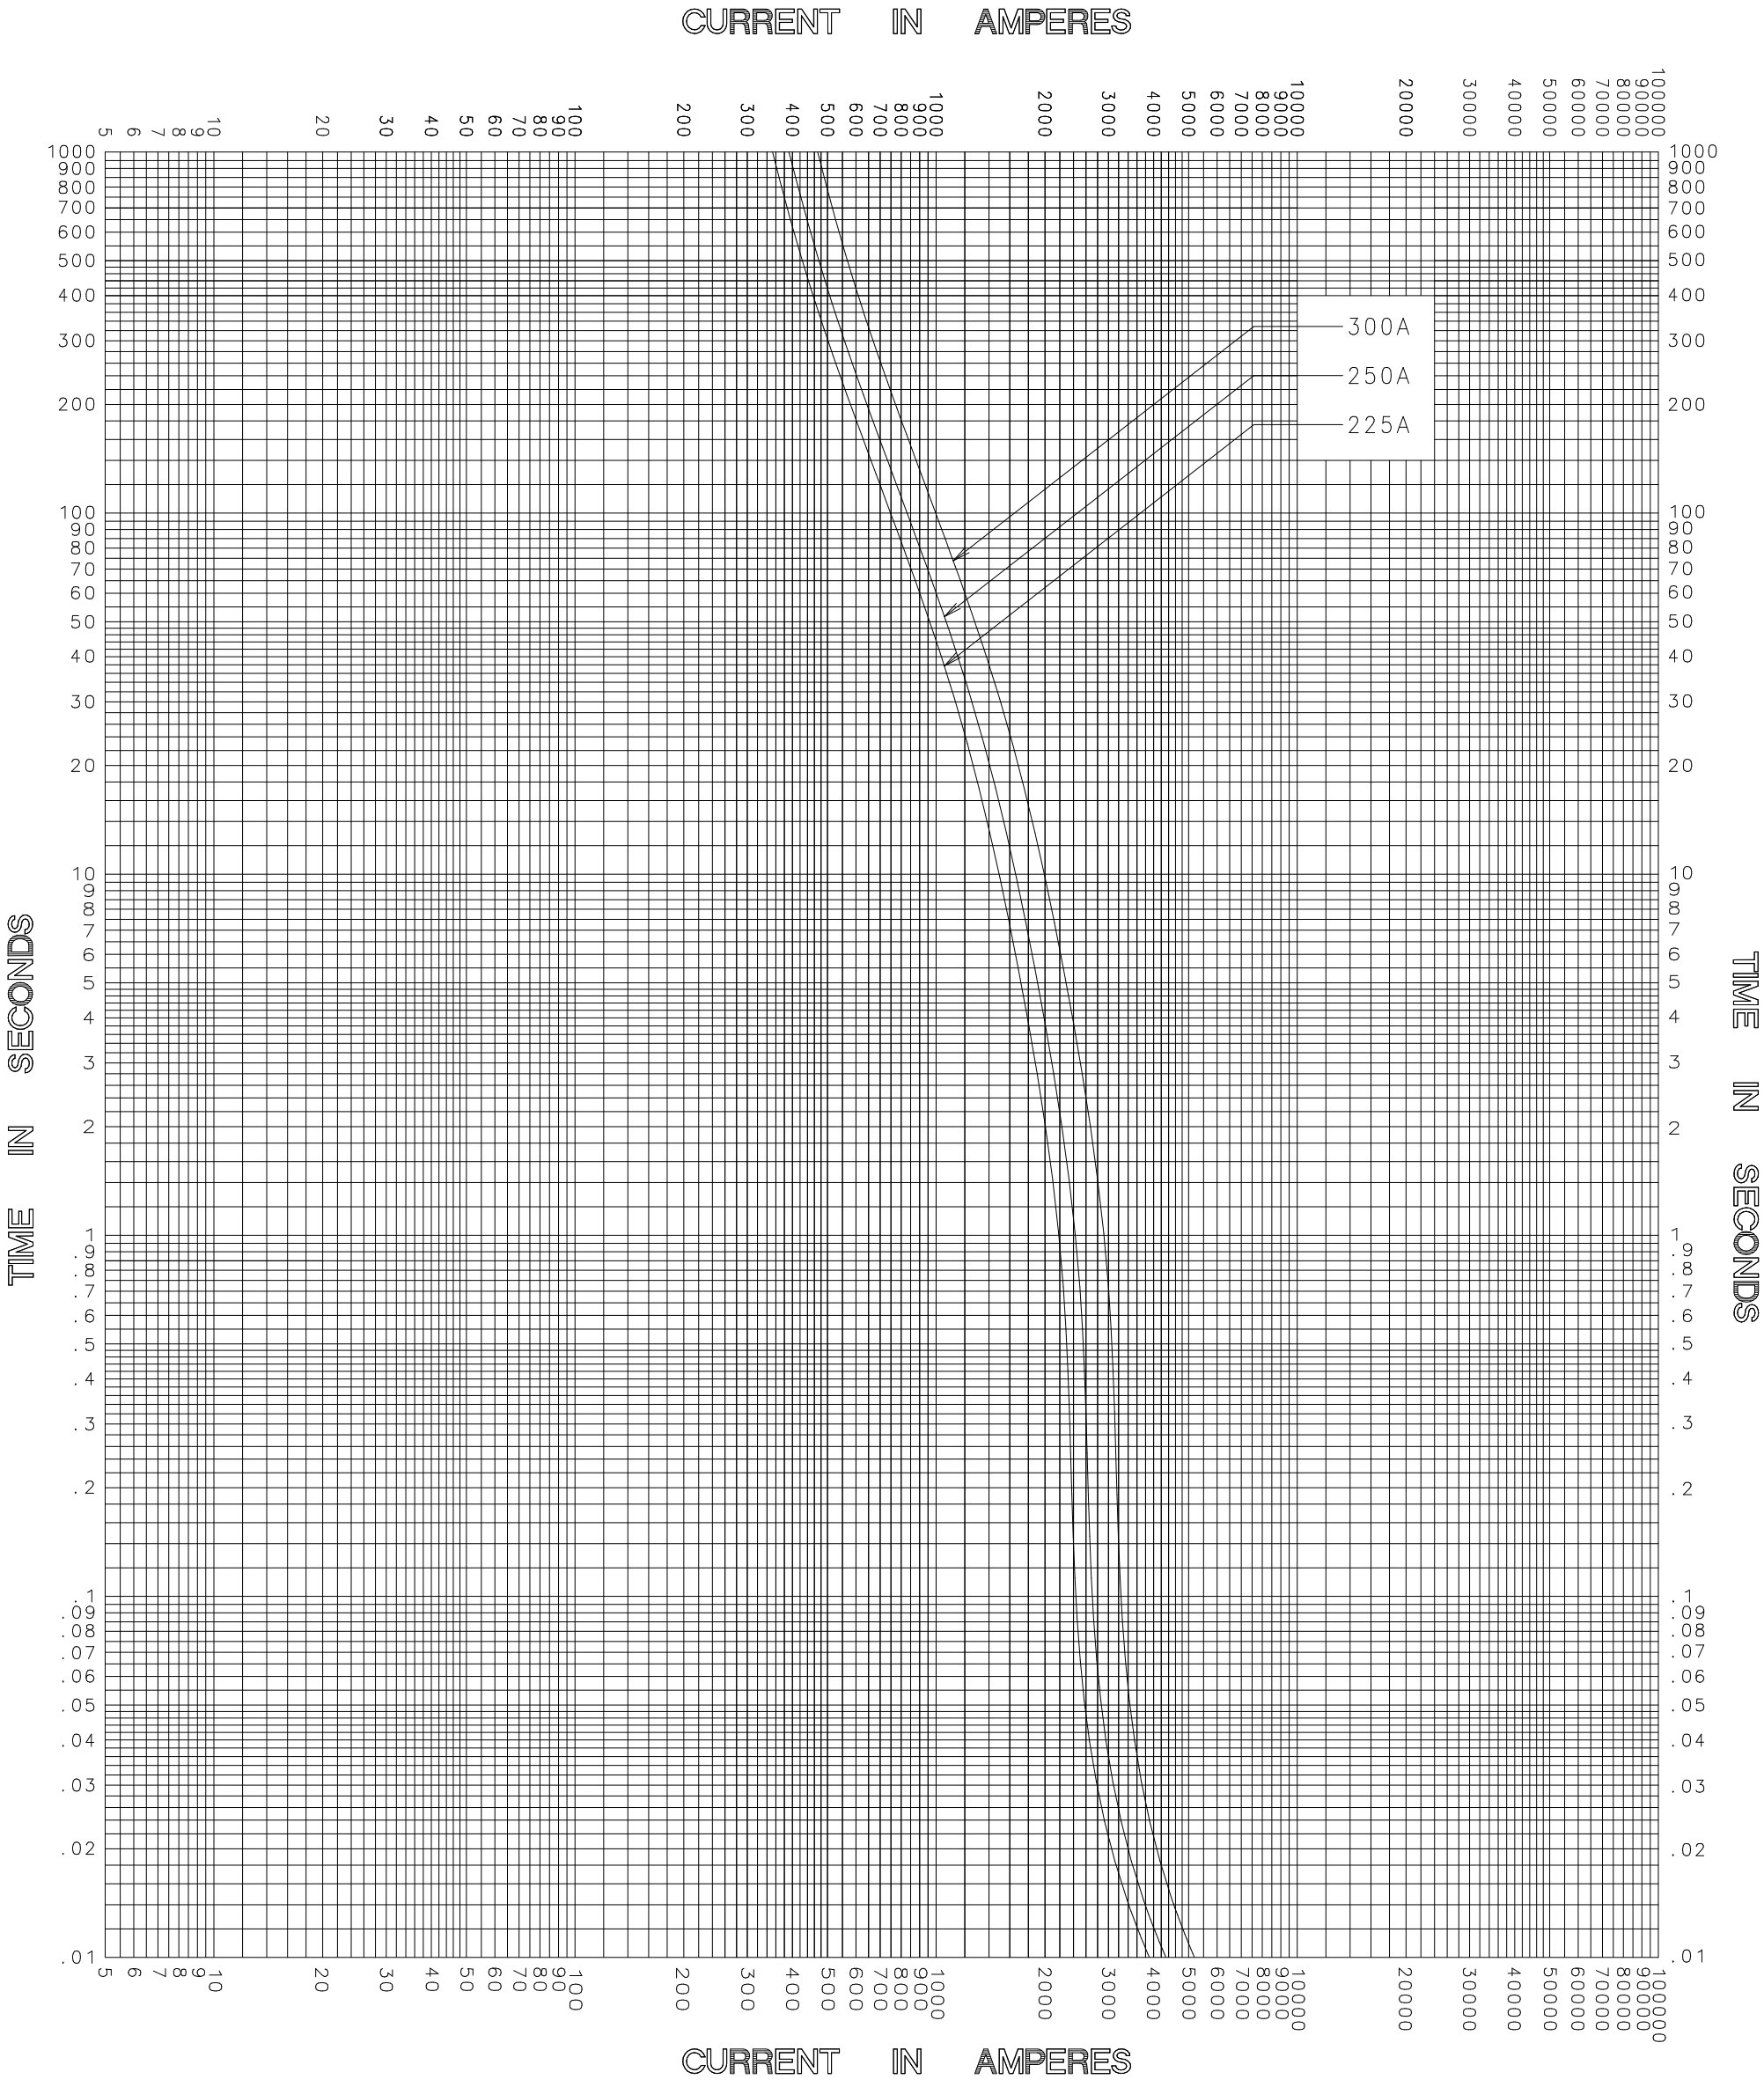


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		LLSRK (225A - 300A) ID

 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>12/03/04</u>
TIME CURRENT CHARACTERISTIC CURVES	CHECKED BY <u>MP</u>
	DRAWING NO. <u>B-FCC01-SRK/JUN015</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

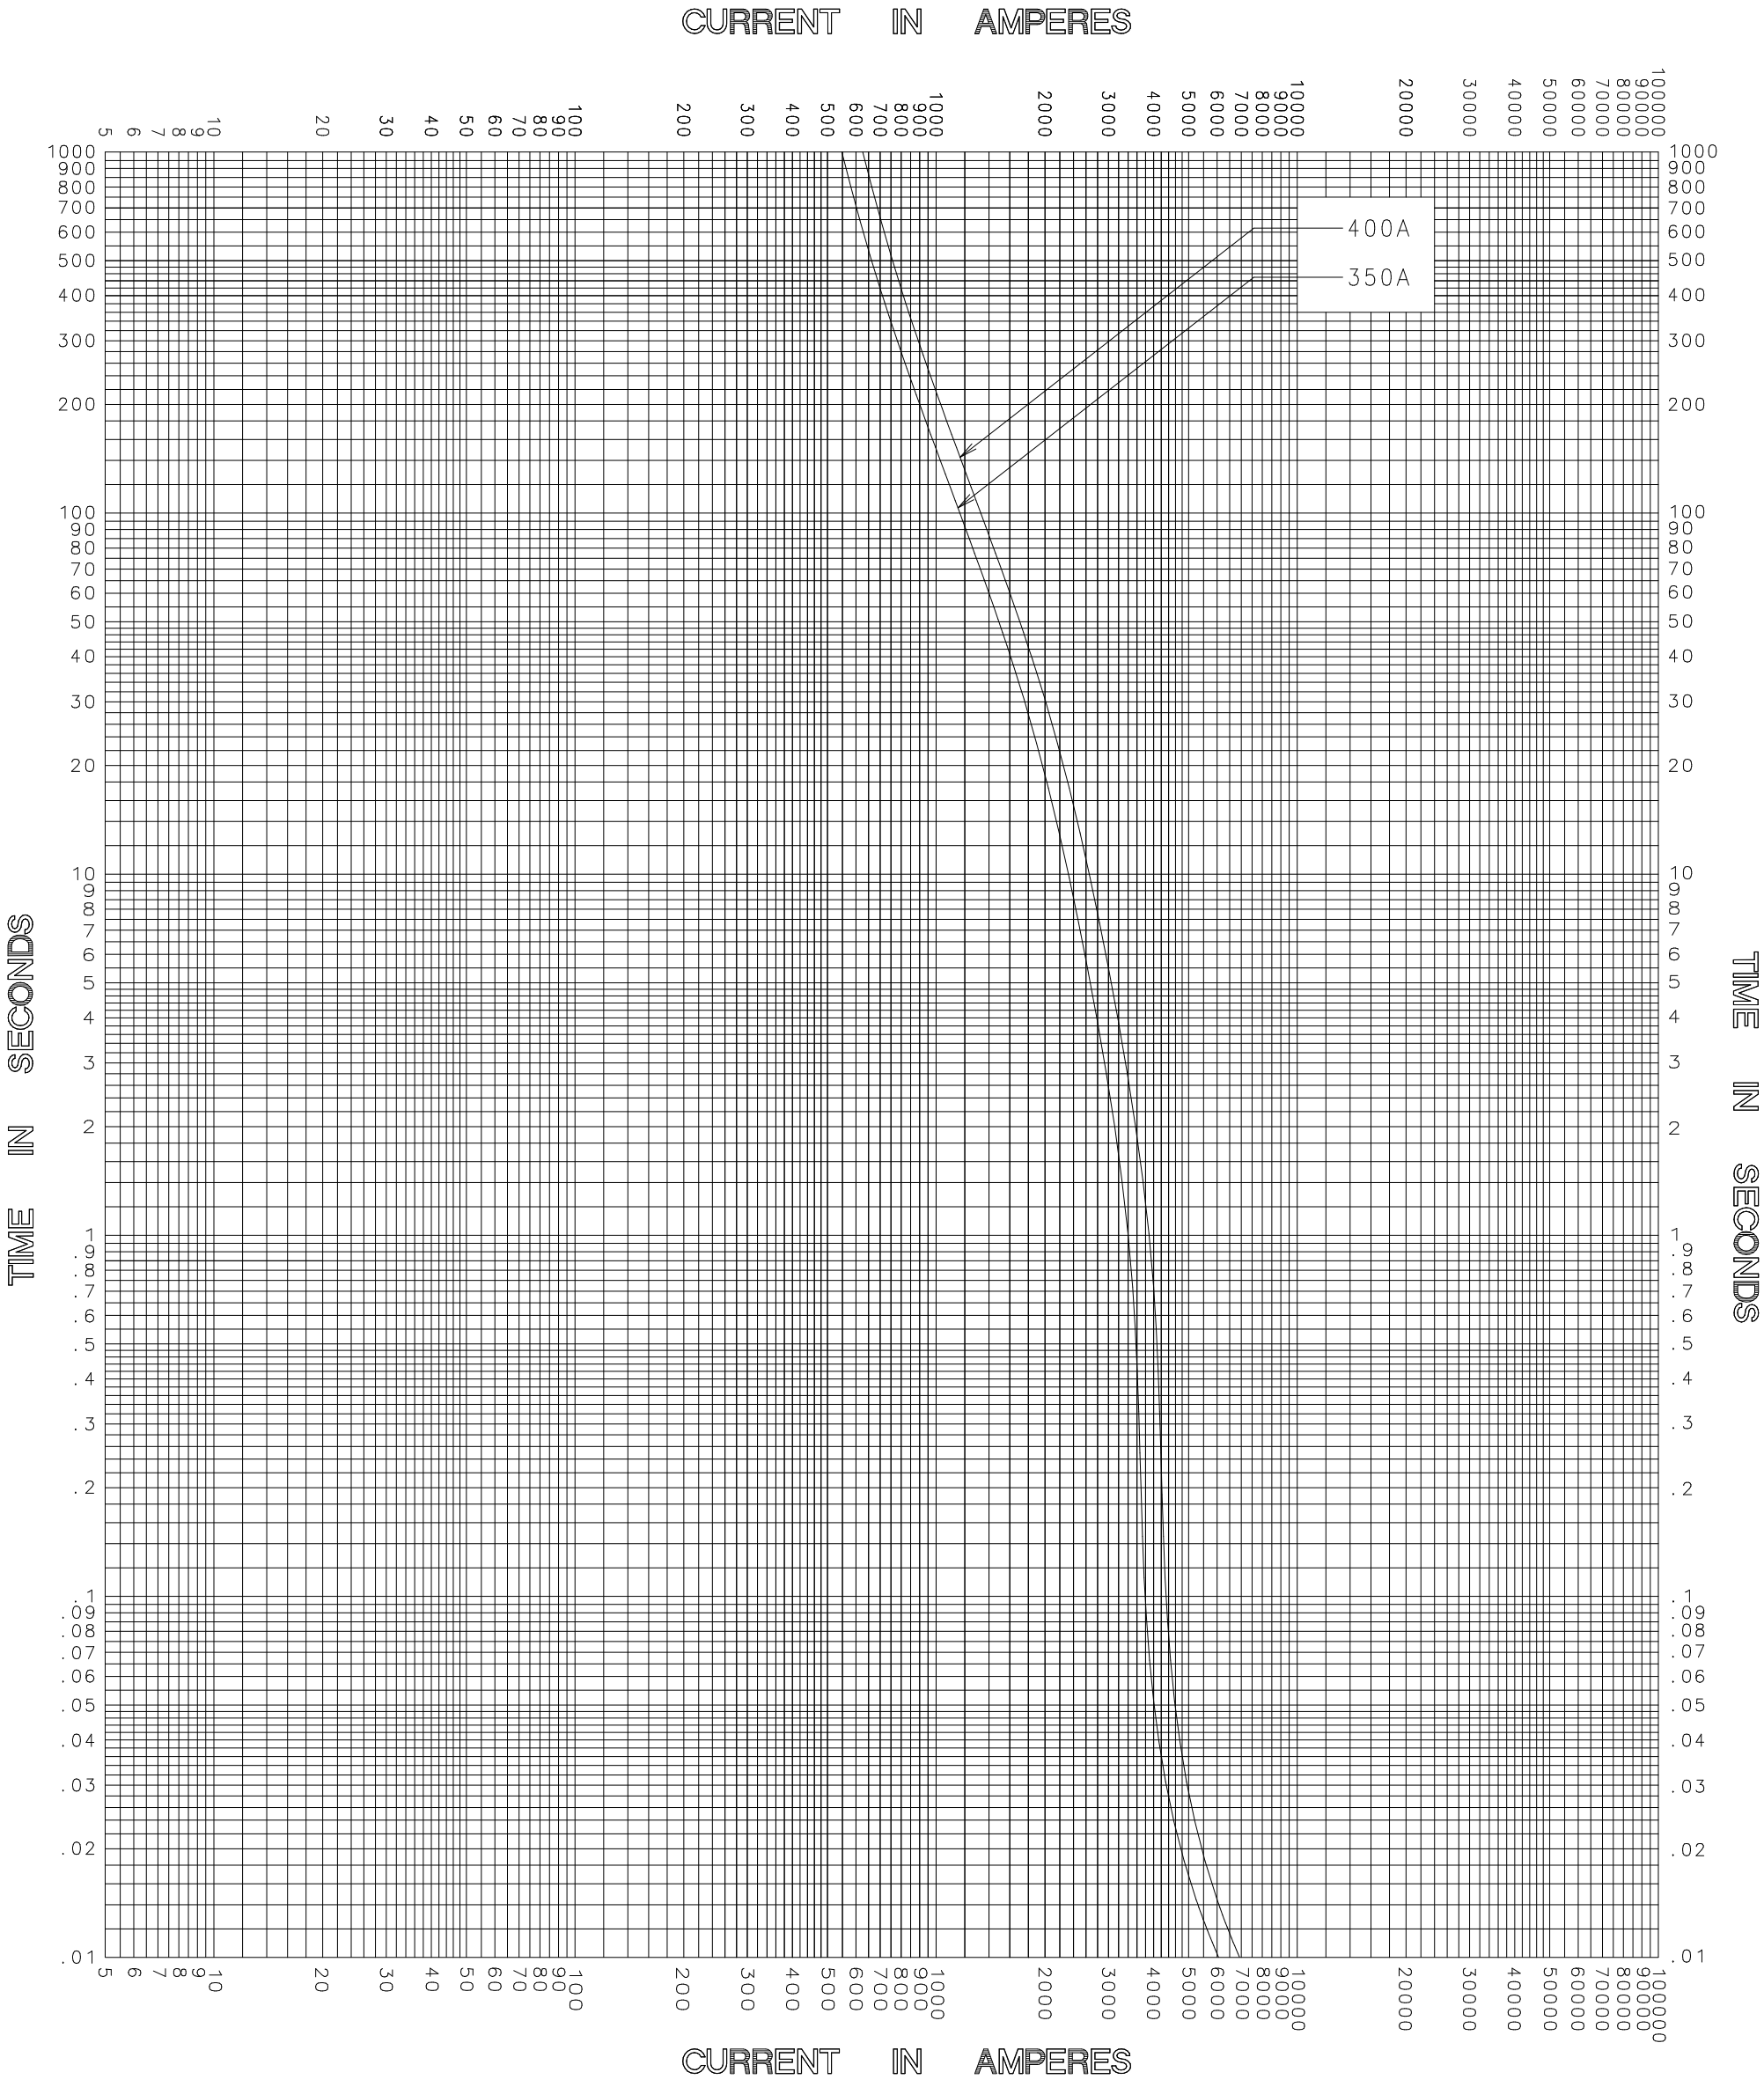


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		LLSRK (350A - 400A) ID

 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>12/03/04</u>
TIME CURRENT CHARACTERISTIC CURVES	CHECKED BY <u>MP</u>
	DRAWING NO. <u>B-FCC01-SRK/JUN 016</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

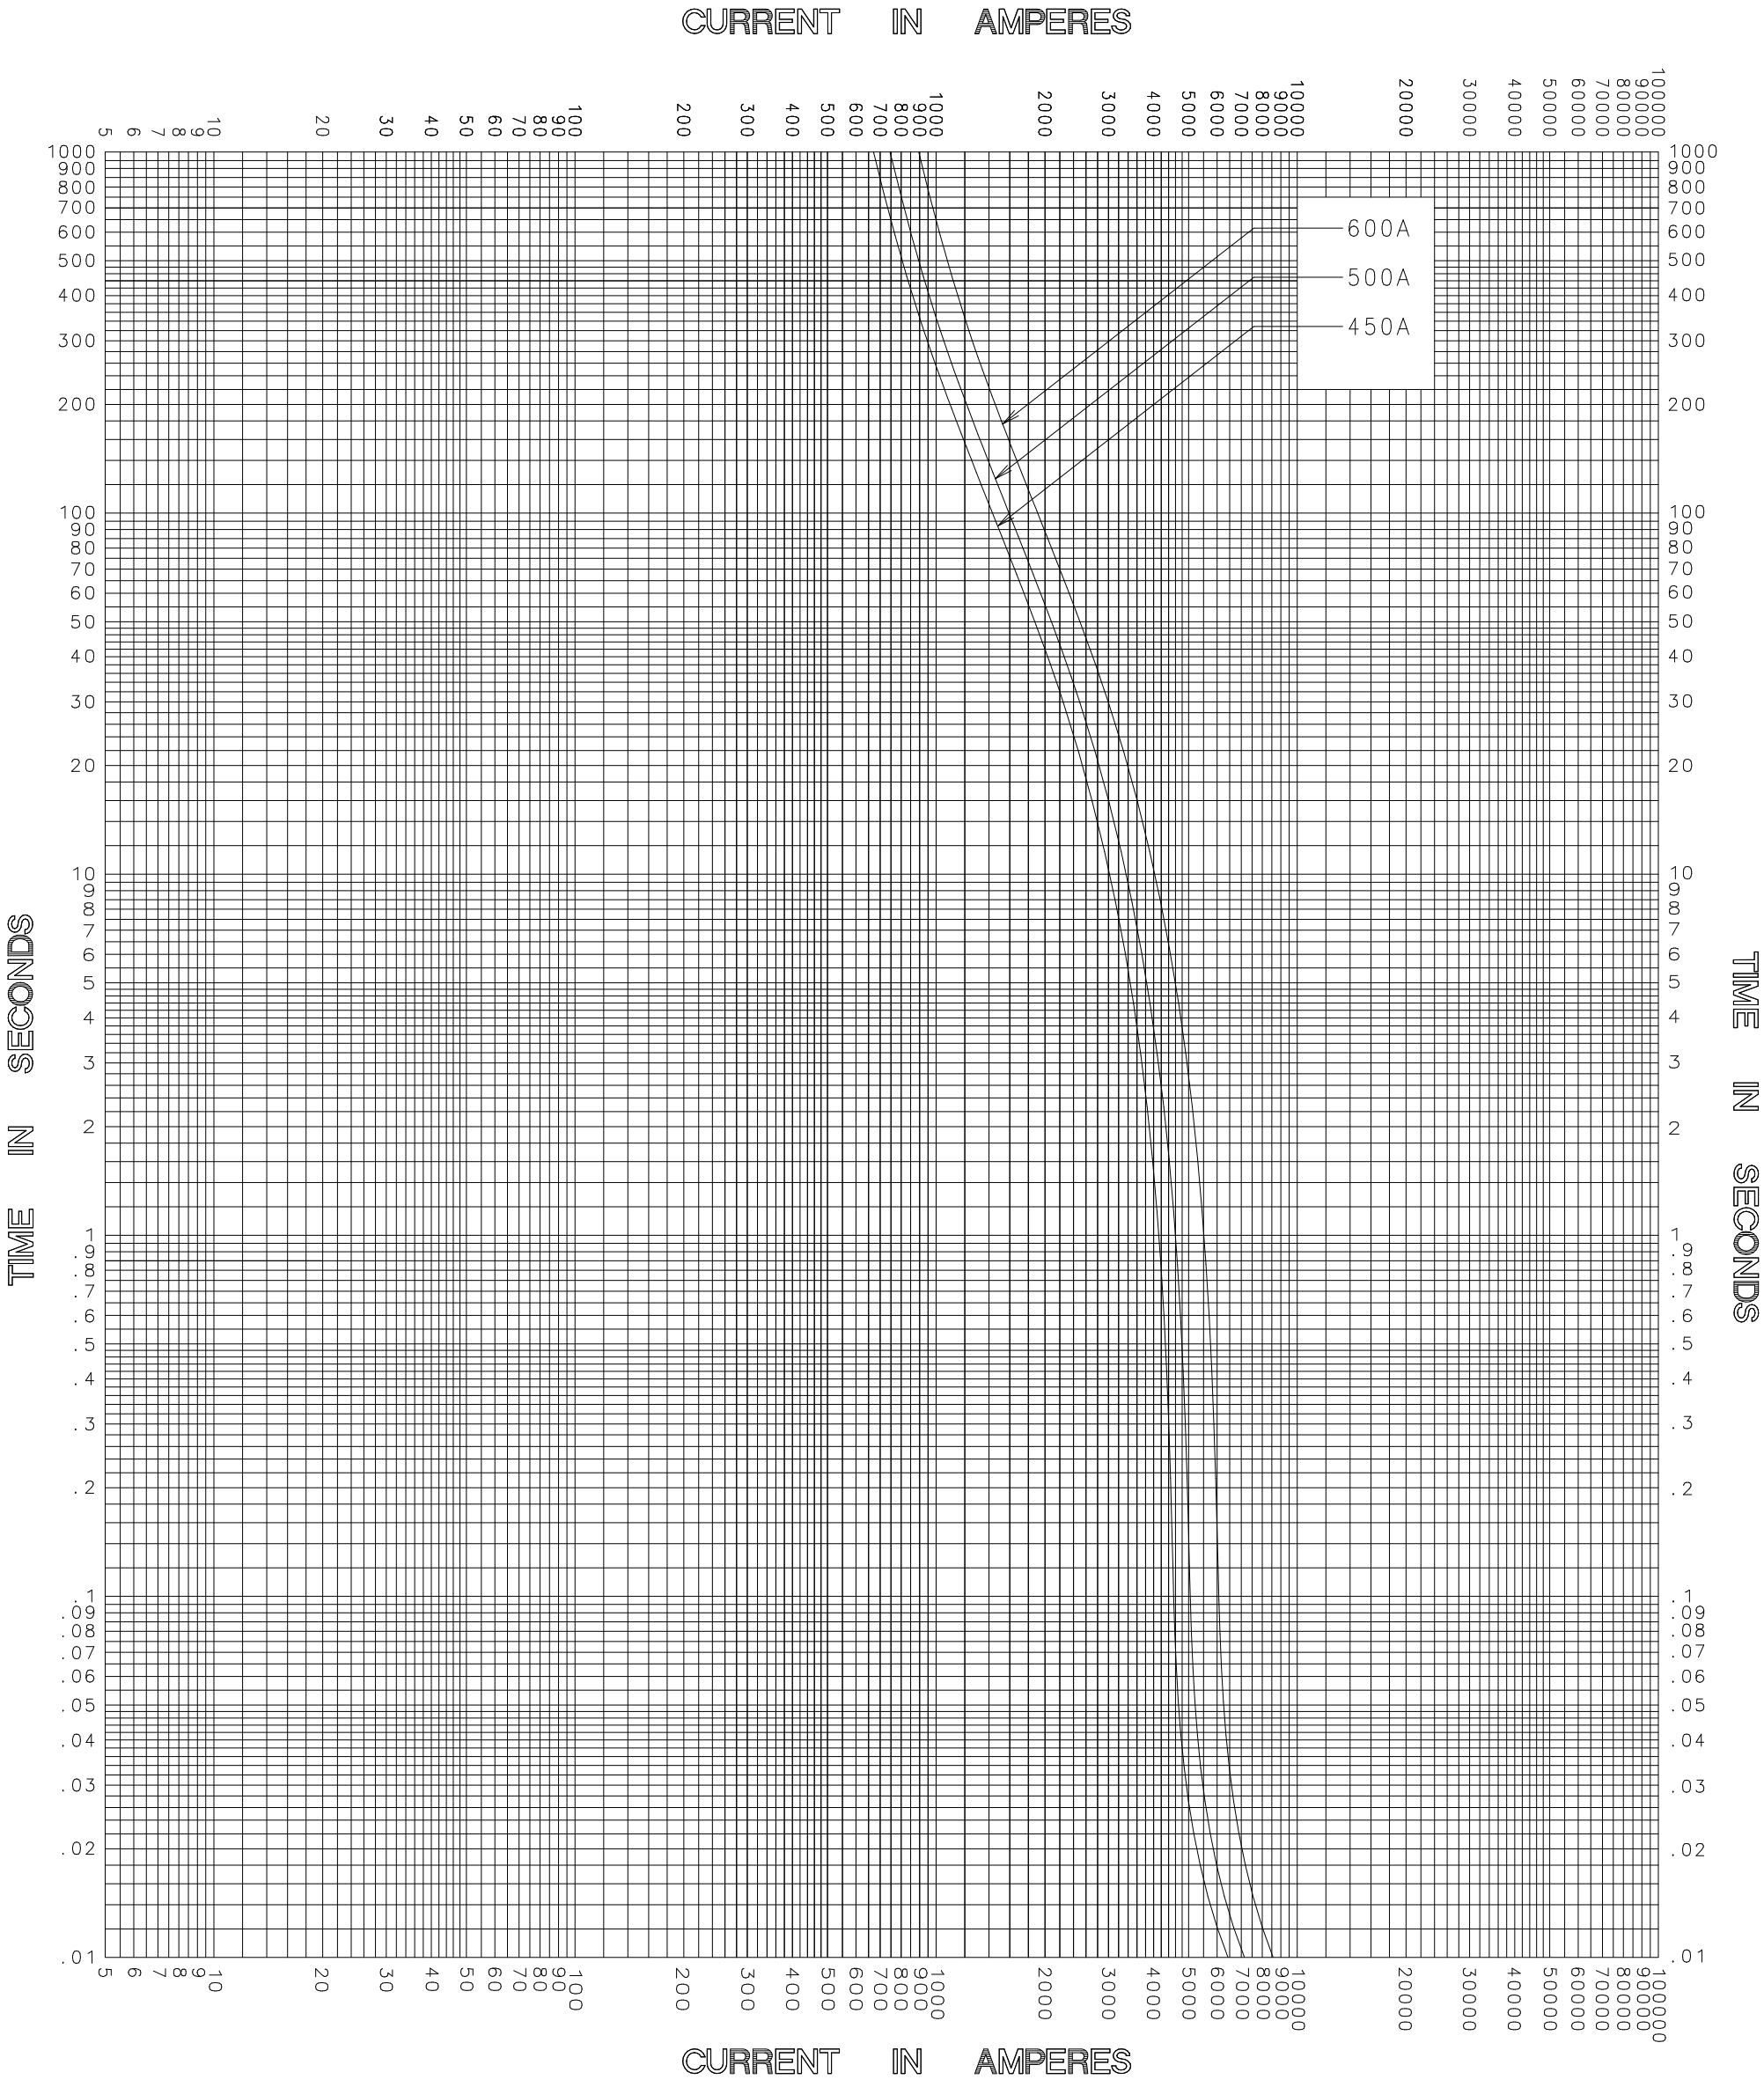

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	LLSRK (450A - 600A) ID

 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u> DATE <u>12/03/04</u> CHECKED BY <u>MP</u>
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. <u>B-FCC01-SRK/ID 017</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT