

Installation Instructions 152EA Deadbreak Cable Entrance Insulating Plug

CONTENTS: *Deadbreak Cable Entrance Insulating Plug, Lubricant (Do Not Substitute), Nylon Venting Rod, Installation Instructions.*

The 152EA is designed for insulating a cable entrance of an Elastimold 25S, 25Y, and 1601CL. Verify that the product cable entrance and the insulating plug sized correspond.

DANGER

All apparatus must be de-energized during installation or removal of part(s). For loadbreak products follow operating instructions. All deadbreak connectors must be de-energized before operating and must be mechanically secured with bails when connected.

All apparatus must be installed and operated in accordance with individual user, local, and national work rules. These instructions do not attempt to provide for every possible contingency.

Do not touch or move energized products by hand.

Excess distortion of the assembled product may result in its failure.

Contact with solvents, transformer oil, motor oil and similar substances will degrade jacket conductivity and insulation level if not immediately wiped off.

FOR MORE INFORMATION ON PARTS, INSTALLATION RATINGS AND COMPATIBILITY, CALL THE NEAREST ELASTIMOLD OFFICE.

Inspect parts for damage, rating and compatibility with mating parts.

This product should be installed only by competent personnel trained in good safety practices involving high voltage electrical equipment. These instructions are not intended as a substitute for adequate training or experience in such safety practices.

Failure to follow these instructions will result in damage to the product and serious or fatal injury.


If this product is supplied with a protective shipping cover(s), remove this shipping cover(s) and replace with the appropriate HV insulated cap(s) or connector(s) before submerging or energizing the circuit.

IMPORTANT

1. Check contents of package to insure they are complete and undamaged.
2. Check all components to insure proper fit with cable and/or mating products.
3. Read entire installation instructions before starting.
4. Have all required tools at hand and maintain cleanliness throughout the procedure.

STEP 1

Lightly lubricate the cable entrance insulating plug for a distance of approximately 5" from the chamfered end. Use the supplied lubricant. **DO NOT SUBSTITUTE.** Other lubricants may be harmful to this product and its mating product(s).

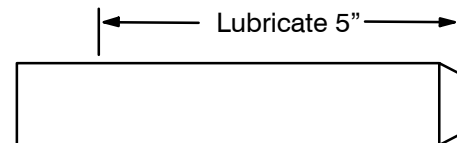


KEEP INSULATING PLUG CLEAN AT ALL TIMES

STEP 2

If the nylon venting rod is not required for installation of the product (refer to installation instructions packaged with the product), disregard the sentences referring to its use.

Insert nylon venting rod approximately 6" into the product cable entrance. Using a twisting motion, push the insulating plug into the product cable entrance until 1" remains protruding from the end of the cable entrance. Remove the nylon venting rod and wipe off excess lubricant.

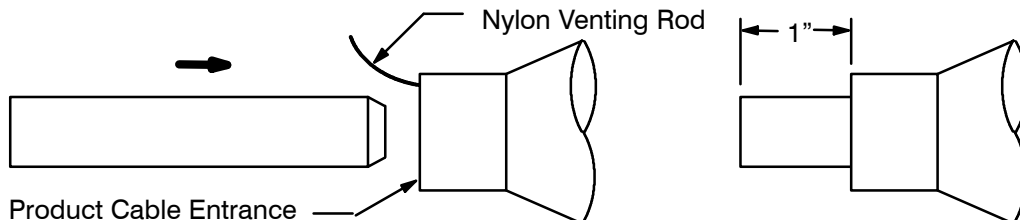

ELASTIMOLD