

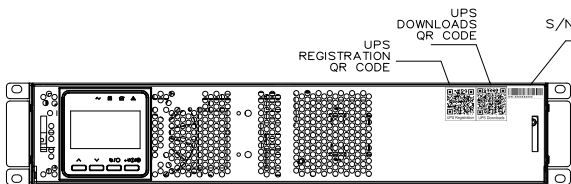

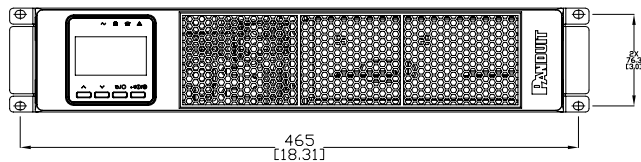


VIEW ROTATED 180°

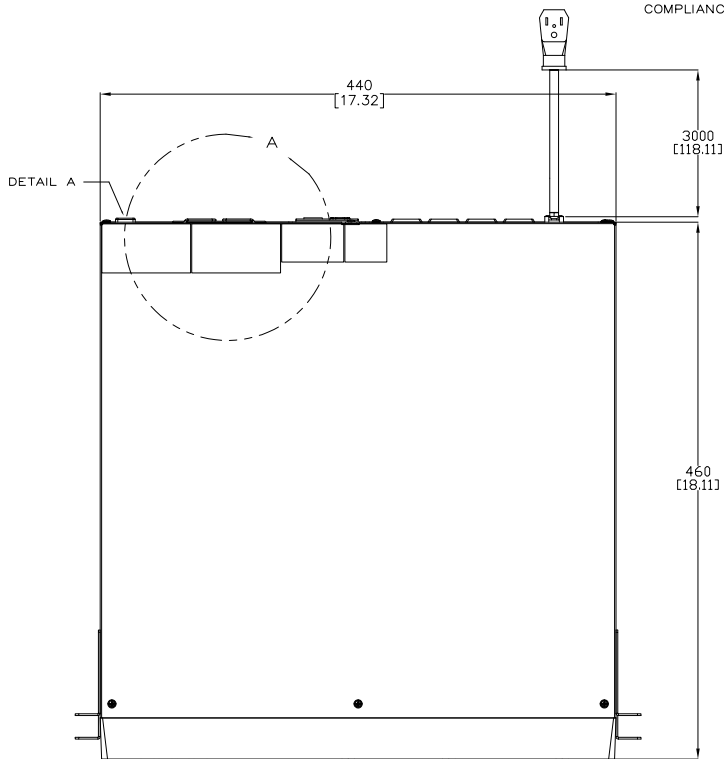

CAUTION LABEL 1 CAUTION LABEL 2

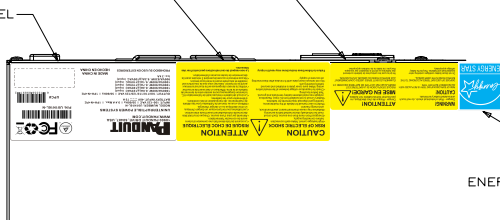

DETAIL A
SCALE 1: 2

SPECIFICATION:

1. STANDARD:

UPS TOPOLOGY:
KVA:
BATTERY TYPE:
FULL-LOAD RUN TIME (MIN):
INPUT PLUG:
NOMINAL INPUT VOLTAGE:
INPUT PHASE:
OUTPUT PHASE:
NOMINAL OUTPUT VOLTAGE:
OUTLET TYPE AND QTY:
DISPLAY TYPE:
PARALLEL PORT SUPPORT:
INPUT BREAKER TYPE:
OUTPUT BREAKER TYPE:

DOUBLE CONVERSION
1
LITHIUM-ION
120 MINUTES
NEMA 5-15P
100/110/115/120/125VAC
SINGLE
SINGLE
100/110/115/120/125VAC
NEMA 5-15R(8)
2.8 INCH, 4 BUTTON
NO
16A PUSH BUTTON
N/A

2. ADDITIONAL:

NONE

3. ACCESSORY COMPONENTS:

P/N U01N16L-N CONTAINS A NETWORK MANAGEMENT CARD,(INSTALLED)
NETWORK CARD INCLUDES A SENSOR PORT RJ45 DUST COVER
STABILIZER BRACKET(WITH RUBBER CUSHION),QTY:(4)
INSTALLATION EARS,QTY:(2)
PRODUCT SAFETY WARNING SHEET,QTY:(1)
EPO PLUG WITH SHORTING WIRE,QTY:(1),(INSTALLED)
INCLUDES P/N:URMKIT2 INSTALLATION RAIL KIT, QTY:(1),(U01N16L-N ONLY)
DOCUMENTATION KIT, QTY(1)

NOTES:

1. PRIMARY DIMENSIONS ARE IN MILLIMETERS. SECONDARY DIMENSIONS ARE IN INCHES
2. INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL,STATE,AND LOCAL CODES
3. VISIT OUR ON-LINE CATALOG AT WWW.PANDUIT.COM FOR A CURRENT LIST OF PRODUCTS APPLICABLE FOR USE WITH THIS PRODUCT
4. EXTERNAL BATTERY PACK IS REQUIRED FOR USE. COMPATIBLE WITH UVPL50H (SOLD SEPARATELY).

IDENTIFICATION:

PART NUMBER	DESCRIPTION	SHIPPING WEIGHT (KG)
U01N16L-N	STEADYSINE™ ON-LINE DOUBLE CONVERSION LONG RUNTIME UPS, 1KVA, LITHIUM, 120V, NMC	14.9

										TITLE									
										UPS U01N16L-N CUSTOMER DRAWING									
										NEW NUMBER U01N16L-N/00									
										SUBSTITUTE NAME U01N16L-N-DC/00A									
										UNLESS OTHERWISE SPECIFIED, DIMENSIONAL TOLERANCES ARE IN (IN)									
										REVISION: N/A									
										THIRD ANGLE PROJECTION									
00A 04/03/2025 D.J. M.B./G.L.M. M.J.D./R.R.OOD RELEASE TO PRODUCTION 012153/00										DATE 04/03/2025 BY M.B./G.L.M. CHK VARIOUS									
REV DATE BY CHK APR DESCRIPTION ECN										DATE 04/03/2025 BY M.B./G.L.M. CHK VARIOUS									
2										1									
										SHEET 1 OF 2									

[illegible]