

Steel City

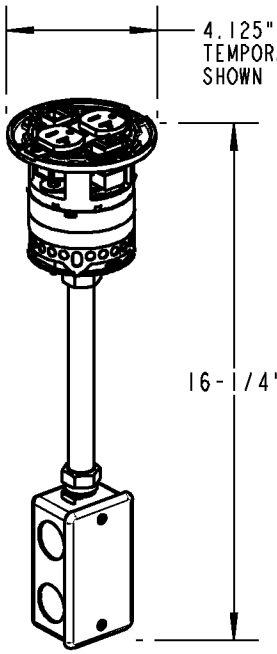

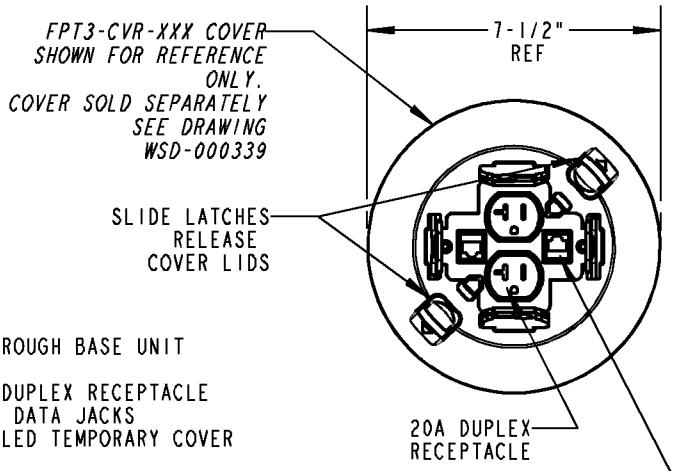

CATALOG NUMBER:

FPT3-2P-2C

FIRE RATED POKE THROUGH BASE UNIT
WITH:
(1) PRE-WIRED 20A DUPLEX RECEPTACLE
(2) LEVITON CAT 5E DATA JACKS
(1) FACTORY INSTALLED TEMPORARY COVER

SPECIFICATIONS / FEATURES:

1. ALL METAL CONSTRUCTION WITH INTUMESCENT MATERIAL (FIRE RETARDANT).
   JUNCTION BOX WITH:
   (4) 3/4" SIDE KNOCKOUTS
   (2) 1/2" BACKSIDE KNOCKOUTS
   (1) 1/2" BOTTOM KNOCKOUT


2. CORE-DRILLED HOLE SIZE: 3 TO 3-1/16" DIAMETER

3. UL LISTED AND CLASSIFIED. MEETS OR EXCEEDS UL AND CANADIAN SAFETY STANDARDS.

4. FIRE RATING AND CONCRETE THICKNESS MIN/MAX:
   FOR USE IN 1, 1-1/2 & 2-HOUR RATED FLOORS
   1-HOUR RATED FLOOR
   2-1/4" THICK MINIMUM CONCRETE OVER STEEL DECKING
   3" MINIMUM CONCRETE FOR REINFORCED SLAB
   7-1/2" MAXIMUM CONCRETE THICKNESS
   2-HOUR RATED FLOOR - CONCRETE THICKNESS MIN/MAX:
   3-1/4" THICK MINIMUM CONCRETE OVER STEEL DECKING
   4" MINIMUM CONCRETE FOR REINFORCED SLAB
   7-1/2" MAXIMUM CONCRETE THICKNESS

5. FLOOR COVERINGS:
   FOR USE ON CARPET AND WOOD COVERED CONCRETE FLOORS, TILE FLOOR COVERINGS UP TO 3/4" MAXIMUM THICKNESS, AND LINOLEUM FLOOR COVERINGS UP TO A MAXIMUM OF 1/8" THICKNESS.
   POKE THROUGH MAY BE INSTALLED DIRECTLY ON CONCRETE IF NO FINISHED FLOOR IS PLANNED.

6. MAXIMUM ALLOWABLE COPPER CROSS-SECTIONAL AREA FOR COMMUNICATIONS:
   SIDE THROUGH HOLE #1: .00321 SQ. INCHES
   CENTER HOLE: POWER
   SIDE THROUGH HOLE #2: .00321 SQ. INCHES

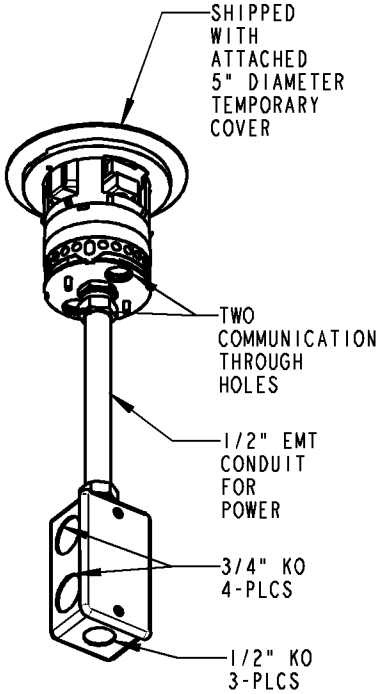

C UL US

GENERAL NOTES

1. ALL DIMENSIONS ARE FOR REFERENCE ONLY.
2. DIMENSIONS IN BRACKETS [ ] ARE IN METRIC UNITS.

REVISIONS

** SEE ERN (****) FOR APPROVAL SIGNATURES & RELEASE DATE. PROJECT NO: ****

Thomas&Betts
www.tnb.com

DESCRIPTION: **FPT3-2P-2C POKE THROUGH BASE UNIT**
COVER SOLD SEPARATELY

ORIGINAL PROJECT NO / (ERN NO)	SHEET NO:	REV. NO:	DRAWING NO:
UD55647 / (2008050)	1 OF 1	-	WSD-000337

THIS DRAWING IS INTENDED FOR DESCRIPTIVE PURPOSES ONLY. AND THE RIGHT IS RESERVED TO DEVIATE FROM ANY OF THE DETAILS SHOWN HEREON.
©2006 Thomas & Betts - Proprietary, All Rights Reserved